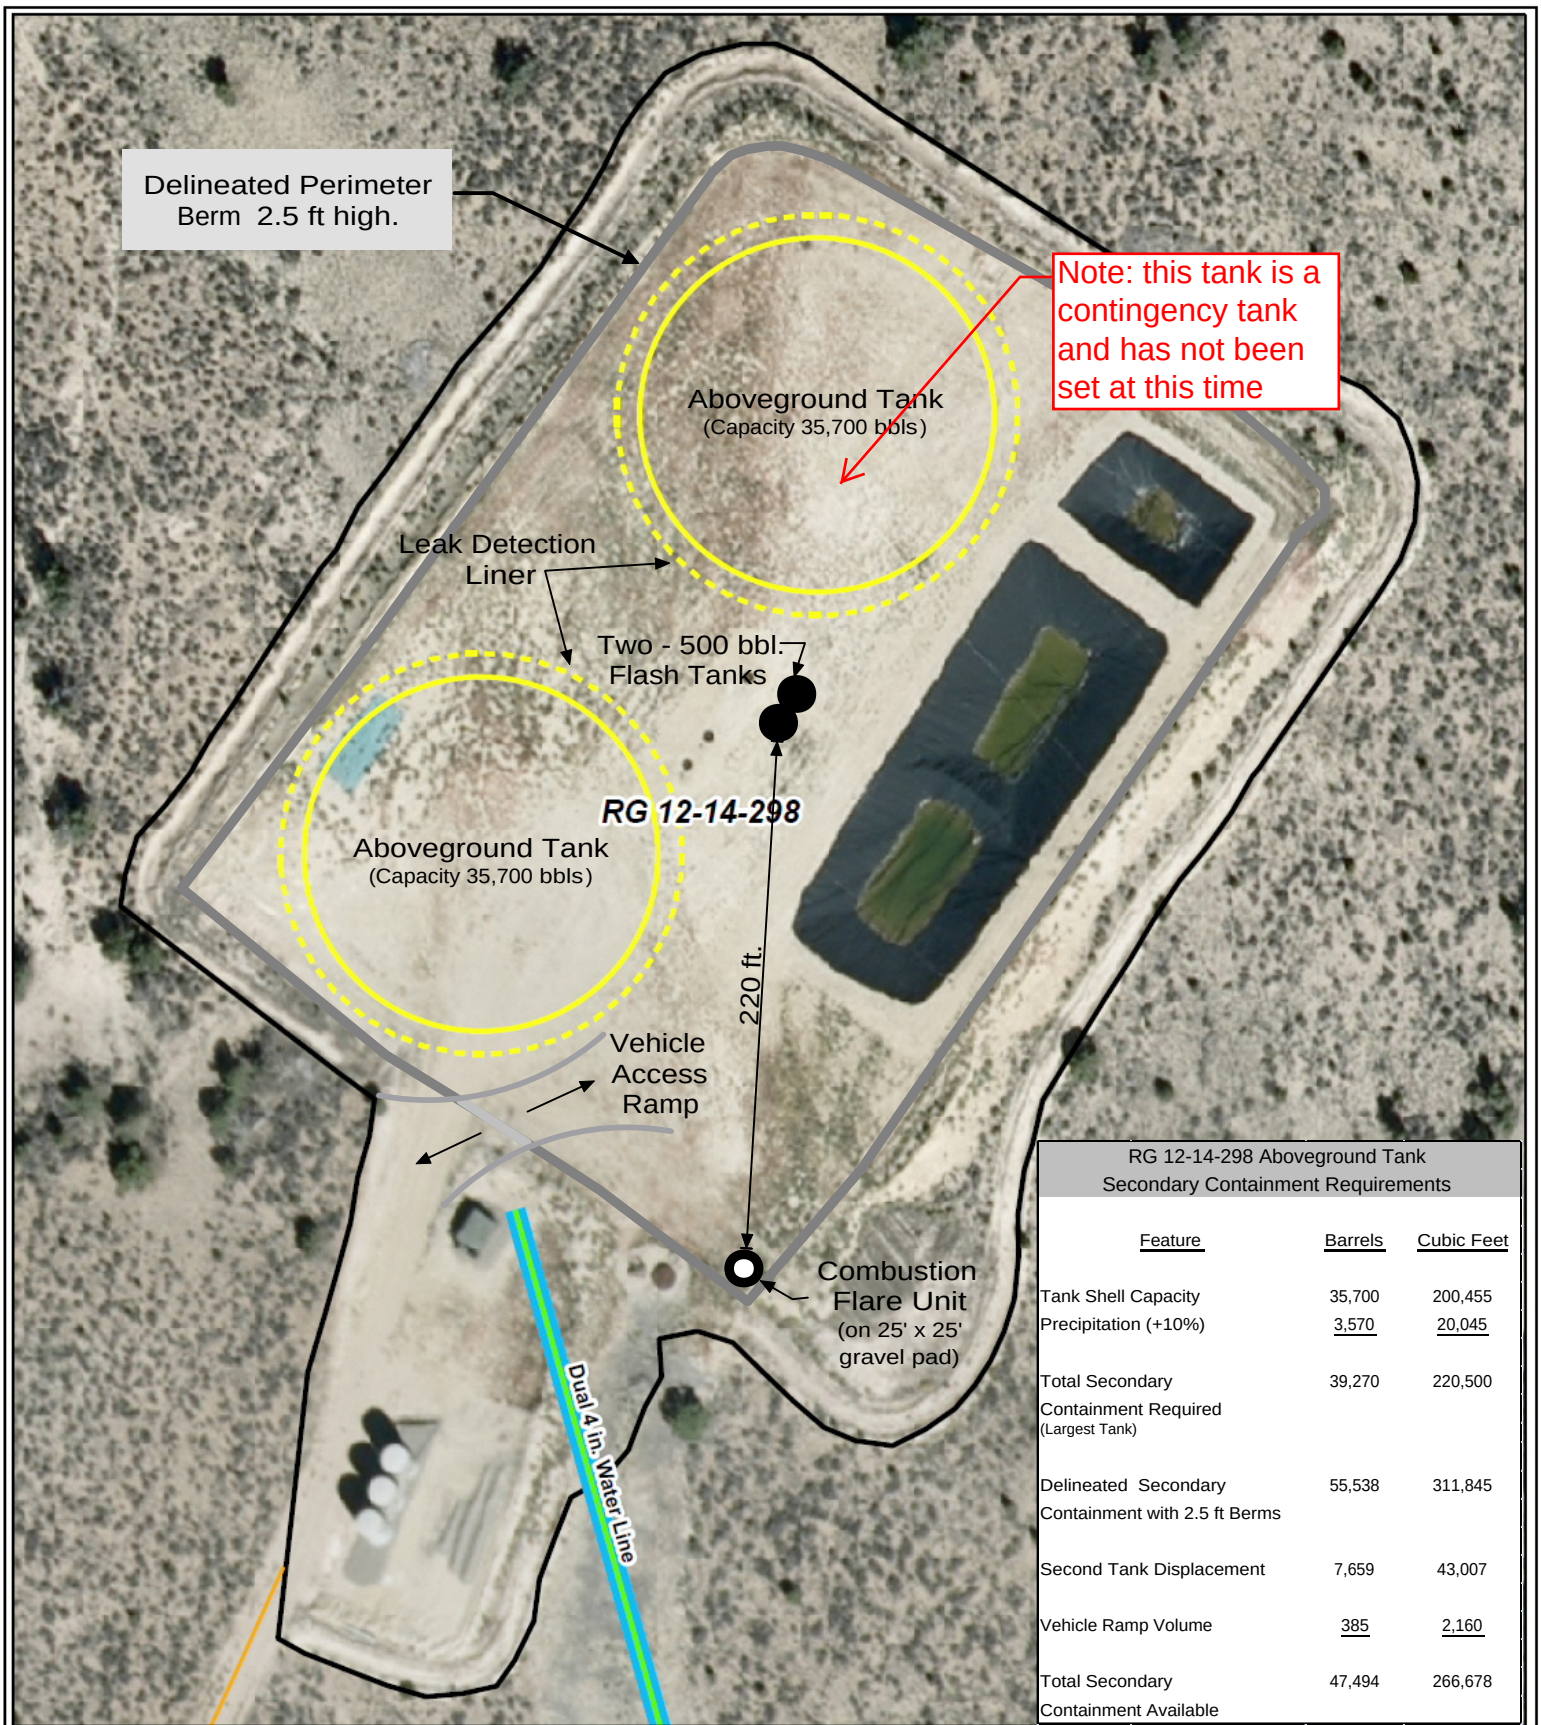

RG 12-14-298 Aboveground Tank
Secondary Containment Requirements

Feature	Barrels	Cubic Feet
Tank Shell Capacity	35,700	200,455
Precipitation (+10%)	3,570	20,045
Total Secondary Containment Required (Largest Tank)	39,270	220,500
Delineated Secondary Containment with 2.5 ft Berms	55,538	311,845
Second Tank Displacement	7,659	43,007
Vehicle Ramp Volume	385	2,160
Total Secondary Containment Available	47,494	266,678

Legend

- Producing Well
- Tank (150' Diameter)
- Tank Buffer (10')
- Road
- Gas Line
- Single 4 in. Water Line
- Dual 4 in. Water Line
- Pad Disturbance

N W E S

0 40 80 160 Feet

WPXENERGY