


# Farney Federal 3-1

Inspection Doc# 675202093

Out of service tank

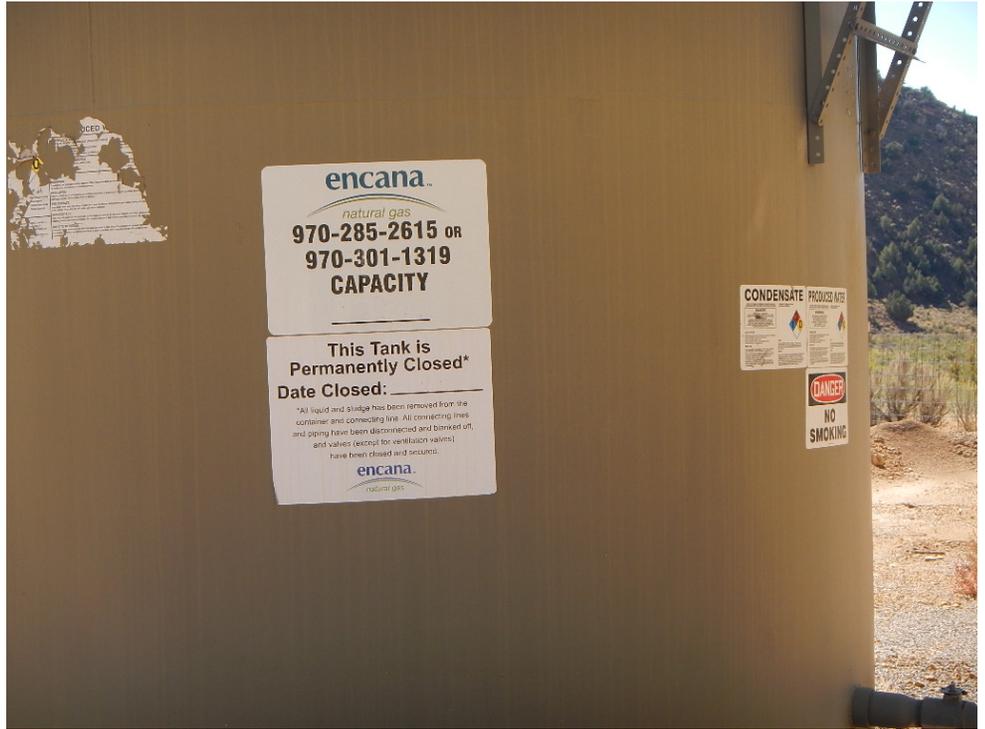

Damaged culvert

