



# Site Facility Diagram

Well Name: Simba 1-06 SWD  
 1/4 1/4: NW/NE Lot 2 Sec: 6 T: 11N R: 62W  
 Latitude: 40.955631 Longitude: -104.362244  
 County: Weld State: Colorado  
 Lease: FEE  
 Type of well: SWD


EOG Resources, Inc. site facility diagrams & site security plans are available electronically at all EOG Resources, Inc. offices. Normal business hours are 7:00am to 4:30pm MST.

Revised: 09/16/2015

Valve	Production Phase	Sales Phase	Water Drain
PV	SO	SC	SC
SV	SC	SO	SC
EV	SO	SC	SC
LV	SC	SO	SC
RV	SC	SC	SC

## Abbreviations

- AM= Allocation Meter
- AR = Access Road
- CHP = Chemical Pump
- CHT = Chemical Tank
- COM = Combuster
- COMP = Compressor
- COMT – Composite Treater
- CONT = Containment Tub
- CP = Charge Pump
- CT = Condensate Tank
- DH = Dehydrator
- DL = Dump Line
- EP = Electrical Panel
- ET = Emergency Tank
- EV = Equalizer Valve
- FE = Fire Extinguisher
- FGS = Fuel Gas Scrubber
- FT = Fiberglass Tub
- FW = Firewall (dimensions feet)
- FWKO = Free Water Knockout
- GB = Gas Buster
- GEN = Generator
- HP = High Pressure
- LACT = LACT Unit
- LH = Line Heater
- LP = Low Pressure
- LV = Load Valve
- MAN = Manifold
- MB = Methanol Bath
- MBT = Methanol Bulk Tank
- MP = Methanol Pump
- OT = Oil Tank
- PIGL = Pig Launcher
- PIGR = Pig Receiver
- PL = Production Line
- POC = Pump Off Controller
- PP = Power Pole
- PRT = Product Tank
- PT = Propane Tank
- PU = Pumping Unit
- PV = Production Valve
- PW = Produced Water Line
- RL = Recycle Line
- RP = Recycle Pump
- RV = Recycle Valve
- SC = Sealed Closed
- SGS = Sales Gas Scrubber
- SL = Sales Line
- SM = Sales Meter
- SO = Sealed Open
- SP = Separator
- SUMP = Sump Pump
- SV = Sales Valve
- T = Treater
- TM = Test Meter
- TP = Trace Pump
- TRFP = Transfer Pump
- TT = Test Treater
- VM = Vent Meter
- VRT = Vapor Recovery Tower
- UNP = Unload Pump
- WDP = Water Disposal Pump
- WD = Water Drain
- WFP = Water Flood Pump
- WH = Wellhead

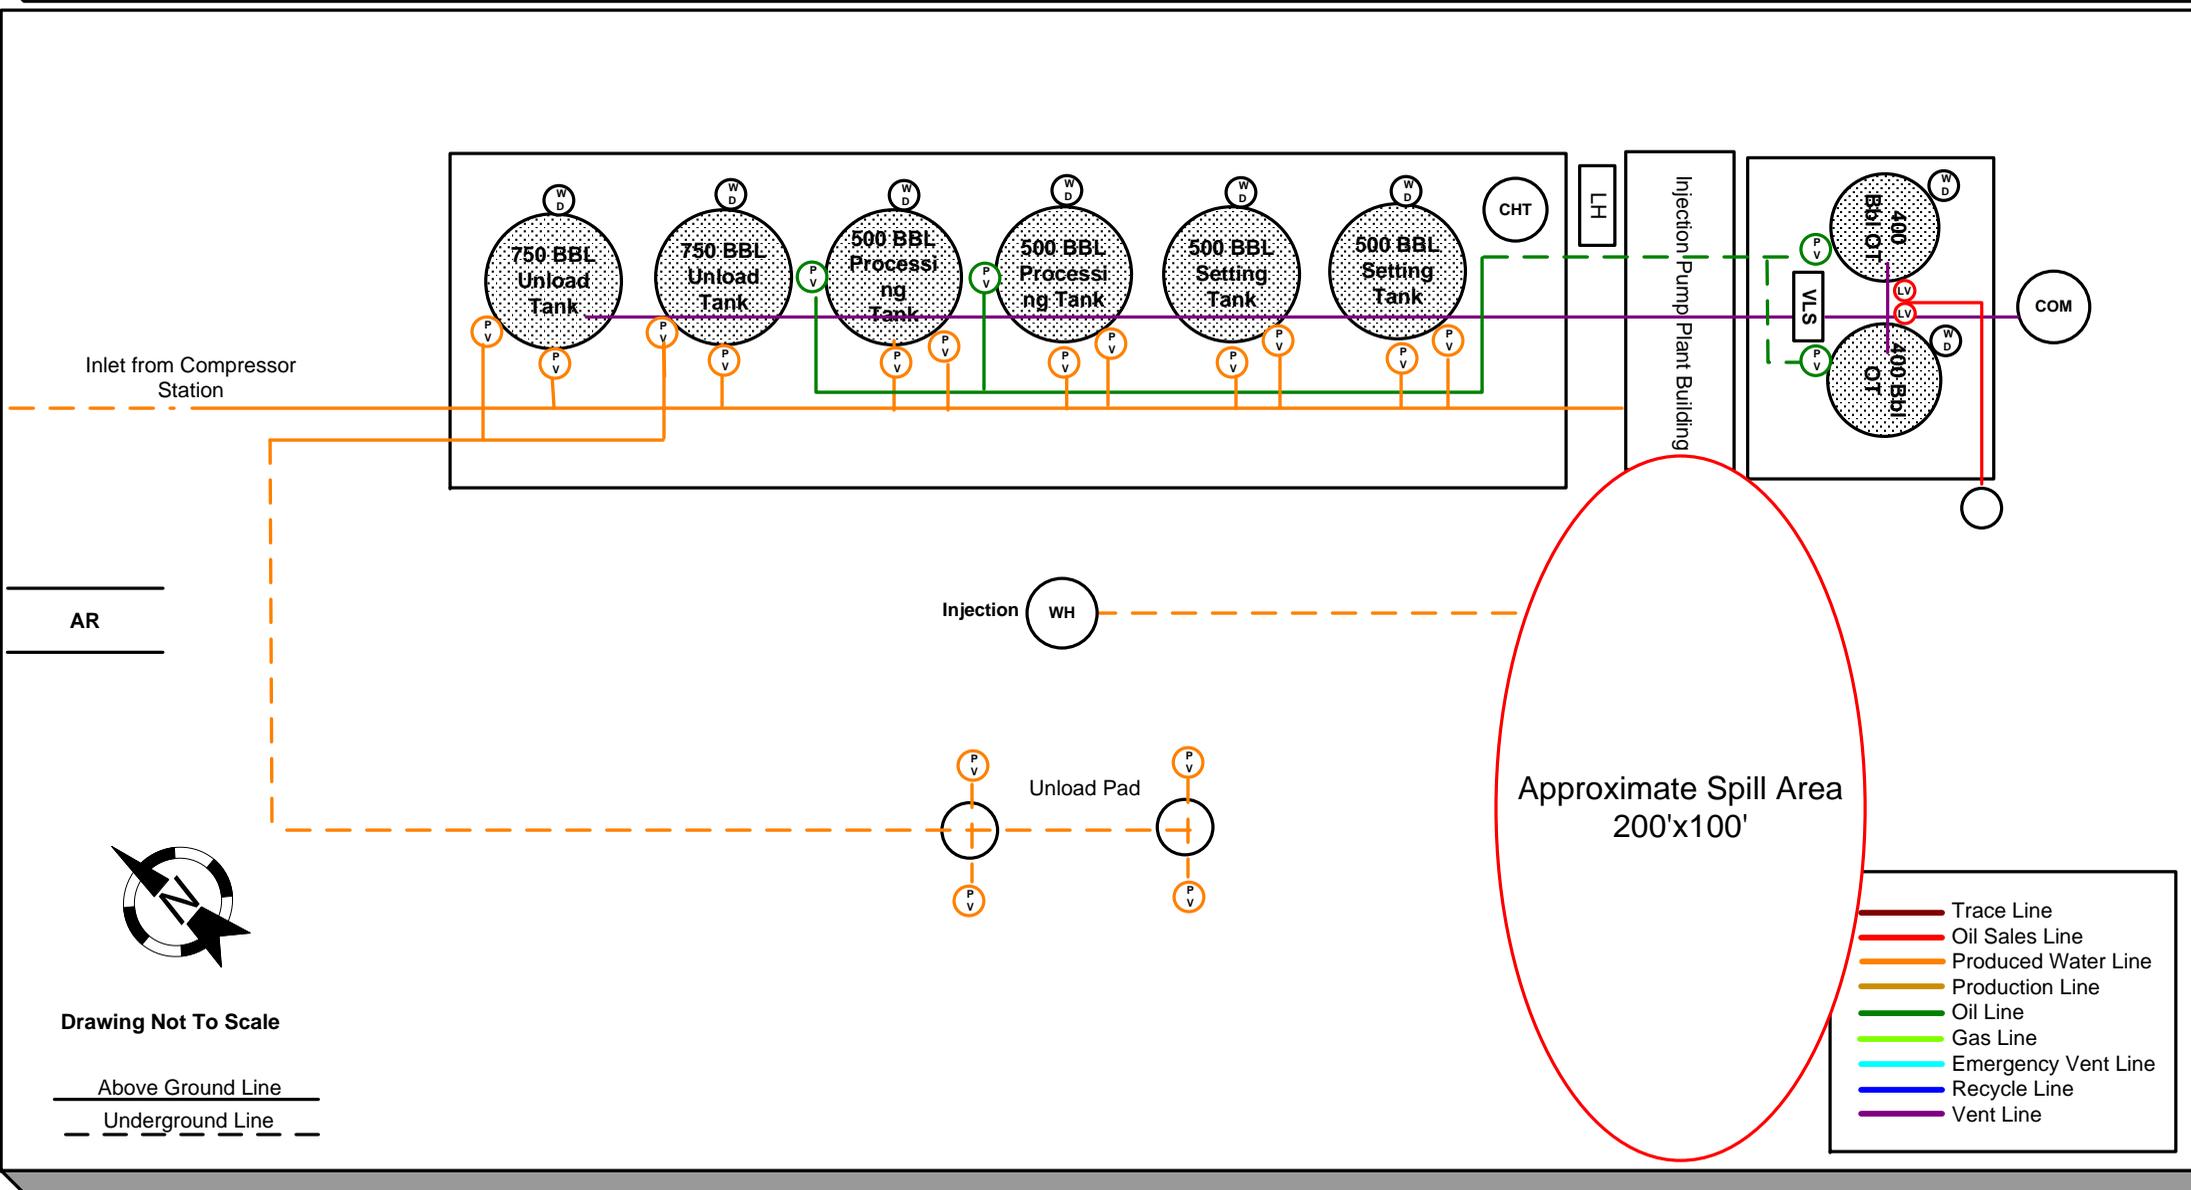

Drawing Not To Scale

Above Ground Line

Underground Line