

Legend


- Well SHL (TEP Future)
- Proposed Gas Pipeline (10")
- Proposed Dump Line (2")
- Proposed Flowline (20-2")
- Proposed Water & Condensate Pipelines (4" Water/2" Condensate)
- Proposed Cellar
- Proposed Tanks
- Proposed Separators
- Proposed Road
- Proposed Daylight Line
- Proposed Pad or Pit
- Proposed Limit of Disturbance

PA 44-13 Pad

**Facility Layout Drawing & Equipment
Setback Dimensions for Construction**

July 18, 2018



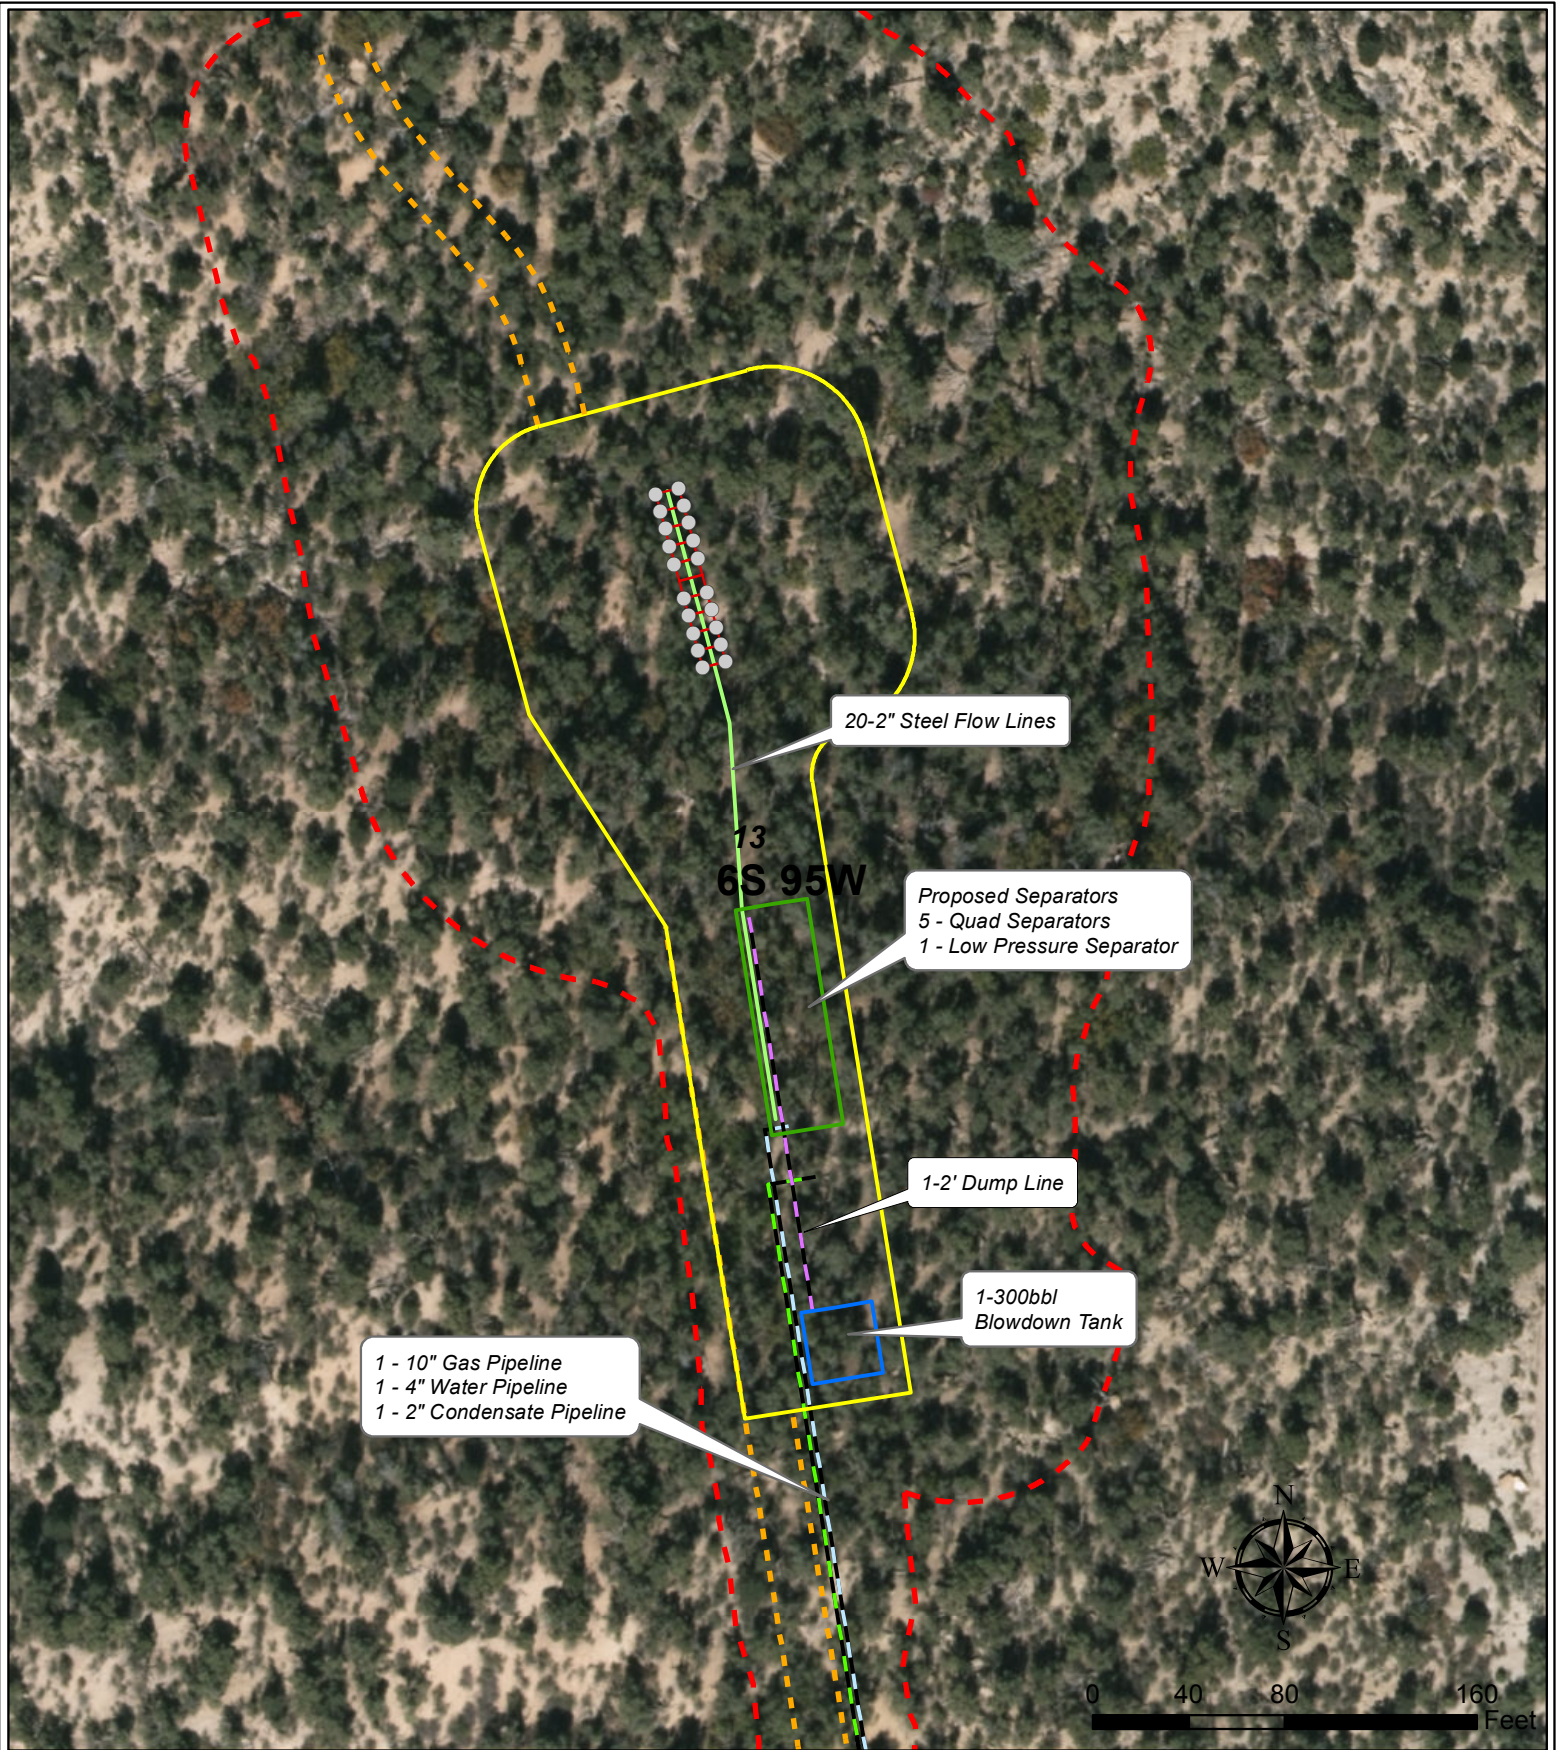

Legend

- | | |
|----------------------------------------------------------------|-------------------------------|
| ● Well SHL (TEP Future) | RECLAIM PAD |
| Proposed Gas Pipeline (10") | Proposed Cellar |
| Proposed Dump Line (2") | Proposed Tanks |
| Proposed Flowline (20-2") | Proposed Separators |
| Proposed Water & Condensate Pipelines (4" Water/2" Condensate) | Proposed Road |
| | Proposed Limit of Disturbance |

PA 44-13 Pad

Facility Layout Drawing & Equipment Setback Dimensions for Interim Reclaim

July 18, 2018

