




18-2N-53W

VIRG'S TESTERS, Inc.

BOX 712—STERLING, COLO.

PHD. 522-1206

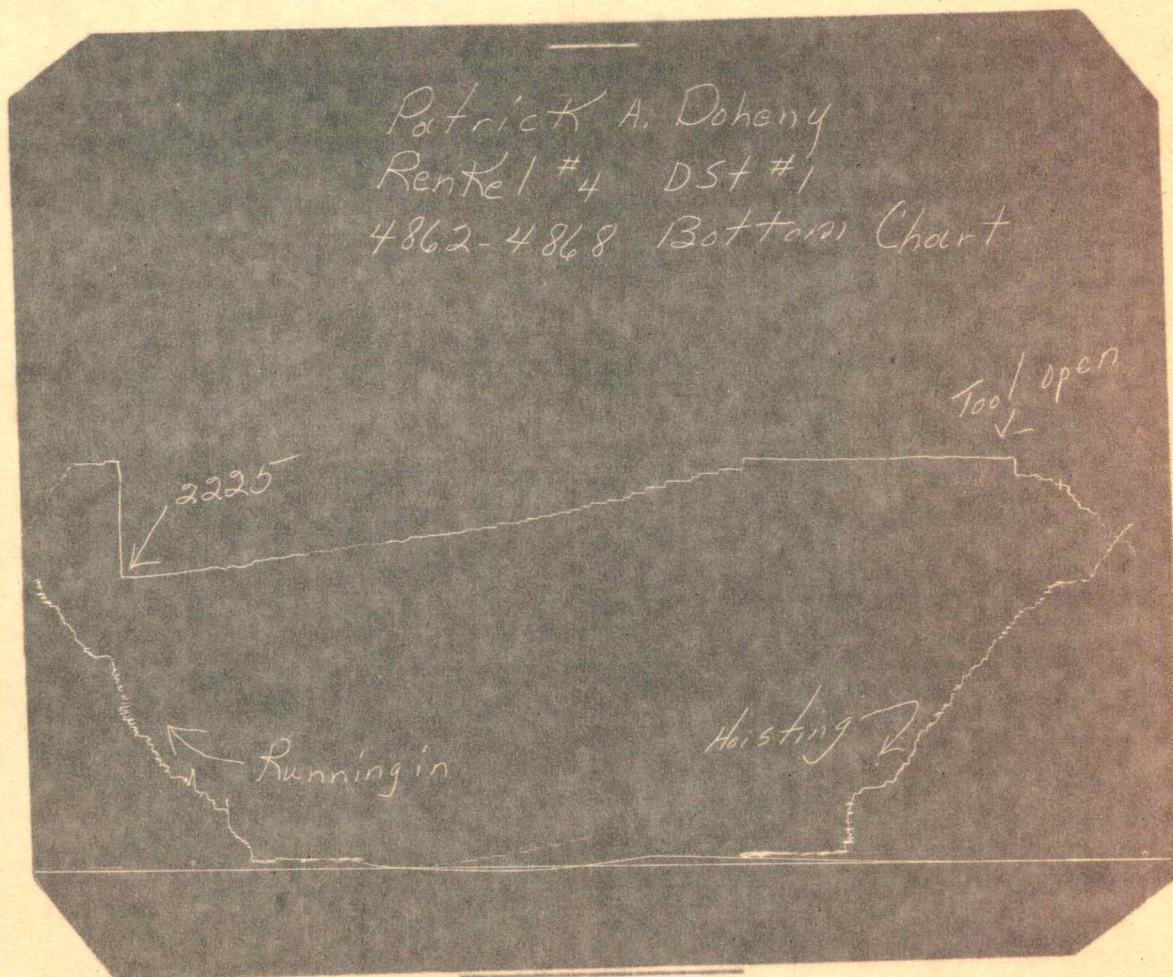

D. S. T. No. 1

Patrick A. Doherty

Renkel # 4

This recorder blanked off below the bottom packer and since pressure bled to only 2225 lbs., which is more than the shut-in pressure, the bottom packer held. Recorder No. 3-S-1