

Location:	CPC 67 Amoco E#1
Line:	MIT of casing
Technicians:	Ed Ingve
Date	3/17/2020
Time	Pressure (PSI)
4:41:10 PM	1
4:41:40 PM	1
4:42:10 PM	1
4:42:40 PM	0.9
4:43:10 PM	1.4
4:43:40 PM	1.4
4:44:10 PM	1.4
4:44:40 PM	4.6
4:45:10 PM	7.7
4:45:40 PM	7.7
4:46:10 PM	358.1
4:46:40 PM	354.2
4:47:10 PM	353.1
4:47:40 PM	344.8
4:48:10 PM	336.8
4:48:40 PM	329.1
4:49:10 PM	321.7
4:49:40 PM	314.4
4:50:10 PM	358.2
4:50:40 PM	357.9
4:51:10 PM	357.7
4:51:40 PM	357.5
4:52:10 PM	357.3
4:52:40 PM	357.1
4:53:10 PM	356.8
4:53:40 PM	356.6
4:54:10 PM	356.3
4:54:40 PM	356.1
4:55:10 PM	355.9
4:55:40 PM	355.7
4:56:10 PM	355.5
4:56:40 PM	355.3
4:57:10 PM	355.1
4:57:40 PM	354.9
4:58:10 PM	354.6
4:58:40 PM	354.4
4:59:10 PM	354.1
4:59:40 PM	353.9
5:00:10 PM	353.7
5:00:40 PM	353.6
5:01:10 PM	353.4
5:01:40 PM	353.2

Start Test

5 minute


10 minute

5:02:10 PM	353
5:02:40 PM	352.8
5:03:10 PM	352.6
5:03:40 PM	352.4
5:04:10 PM	352.3
5:04:40 PM	352.2
5:05:10 PM	352.1
5:05:40 PM	352
5:06:10 PM	351.9
5:06:40 PM	344.5
5:07:10 PM	251.2
5:07:40 PM	351.4
5:08:10 PM	129.8
5:08:40 PM	3.1
5:09:10 PM	1.4
5:09:40 PM	1.4
5:10:10 PM	1.4
5:10:40 PM	1.5
5:11:10 PM	1.5
5:11:40 PM	1.5
5:12:10 PM	1.5
5:12:40 PM	1.5
5:13:10 PM	1.5
5:13:40 PM	1.5
5:14:10 PM	1.5

15 minute

Pass/Fail

% loss over 15 minutes	1.62%	Less than 10%	Yes		
% loss in last 5 minutes	0.42%	Less than 1%	Yes		Pass

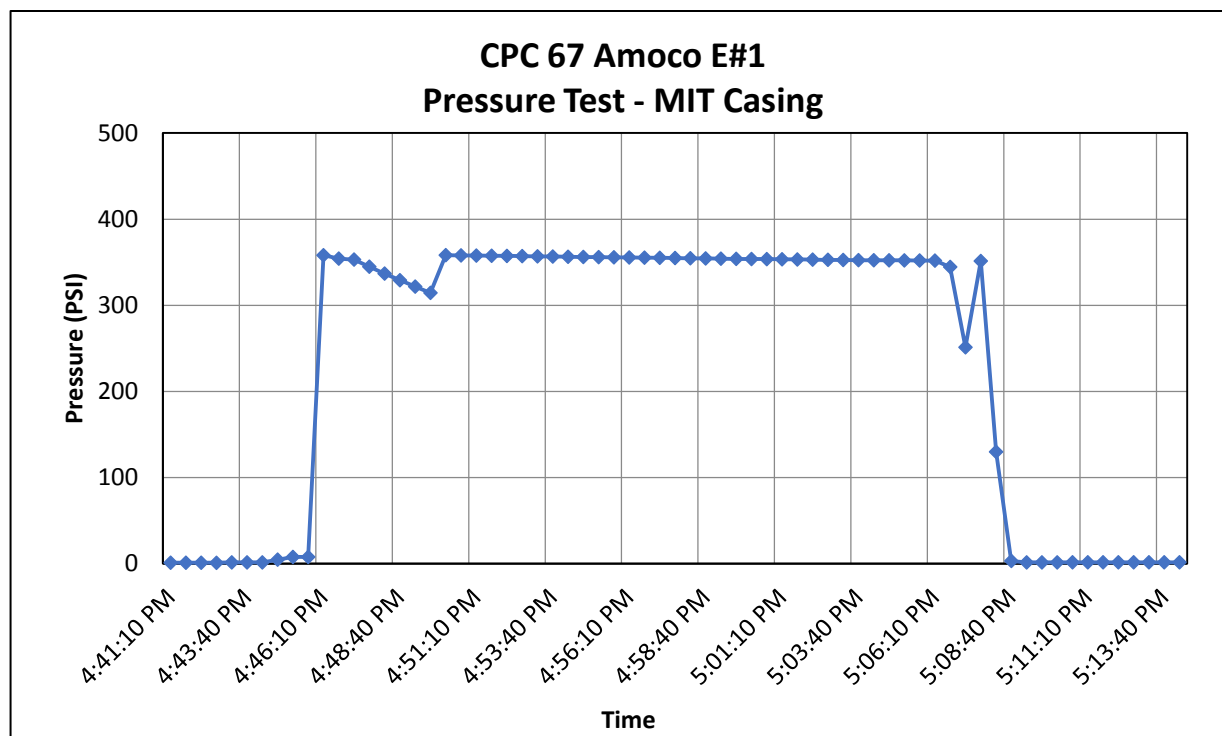

Date - 3/17/2020

Well Name - CPC 67 Amoco E#1

API No. - 05-001-06675

Recorder - Edward Ingve

Recording Device - Dickinson PR 525

Device Range (psi) - 0-500

Starting Pressure - 357.7 psi

5 Minute Pressure - 355.5 psi

10 Minute Pressure - 353.4 psi

15 Minute Pressure - 351.9 psi