

Federal 2S-95-16-22CP



**Fluid Removed from Cellar
July 22, 2020**




Federal 2S-95-16-22CP



Labels Installed on Open Top Tank
July 22, 2020



Federal 2S-95-16-22CP

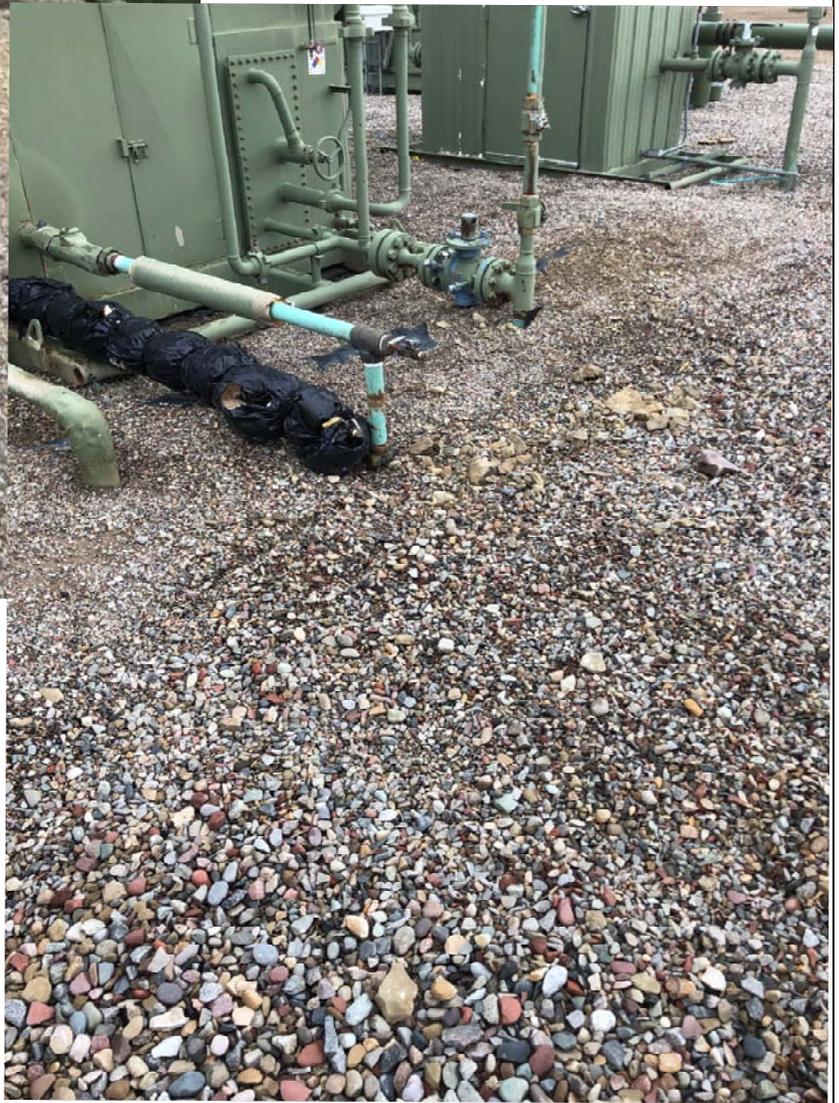

**Unused Equipment Removed
July 22, 2020**

