


ENDERSON 6-11 -- 05-123-20559 -- Aqueous pH Chart

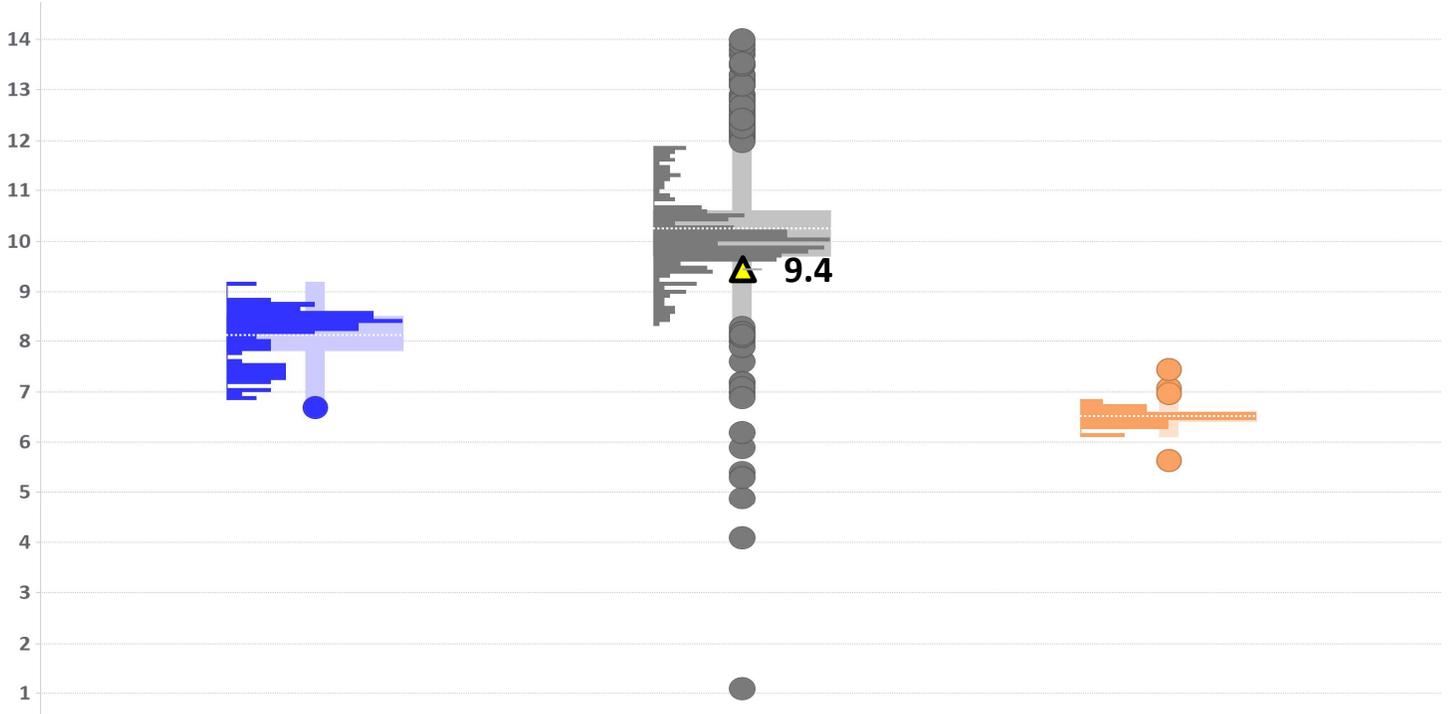

| | Baseline Water Quality Aquifer Sample | Bradenhead Water Sample | Production Water Sample |
|----------|---------------------------------------|-------------------------|-------------------------|
| Count | 111 | 470 | 74 |
| Outliers | 1 | 86 | 8 |
| Avg | 8.13342 | 10.2491 | 6.52339 |

BRADENHEAD WATER SAMPLE OBTAINED 03/03/20 pH 9.44 NOT INDICATIVE OF AQUIFER WATER