


REYNOLDS 9-30 -- 05-123-19178 -- Aqueous pH Chart

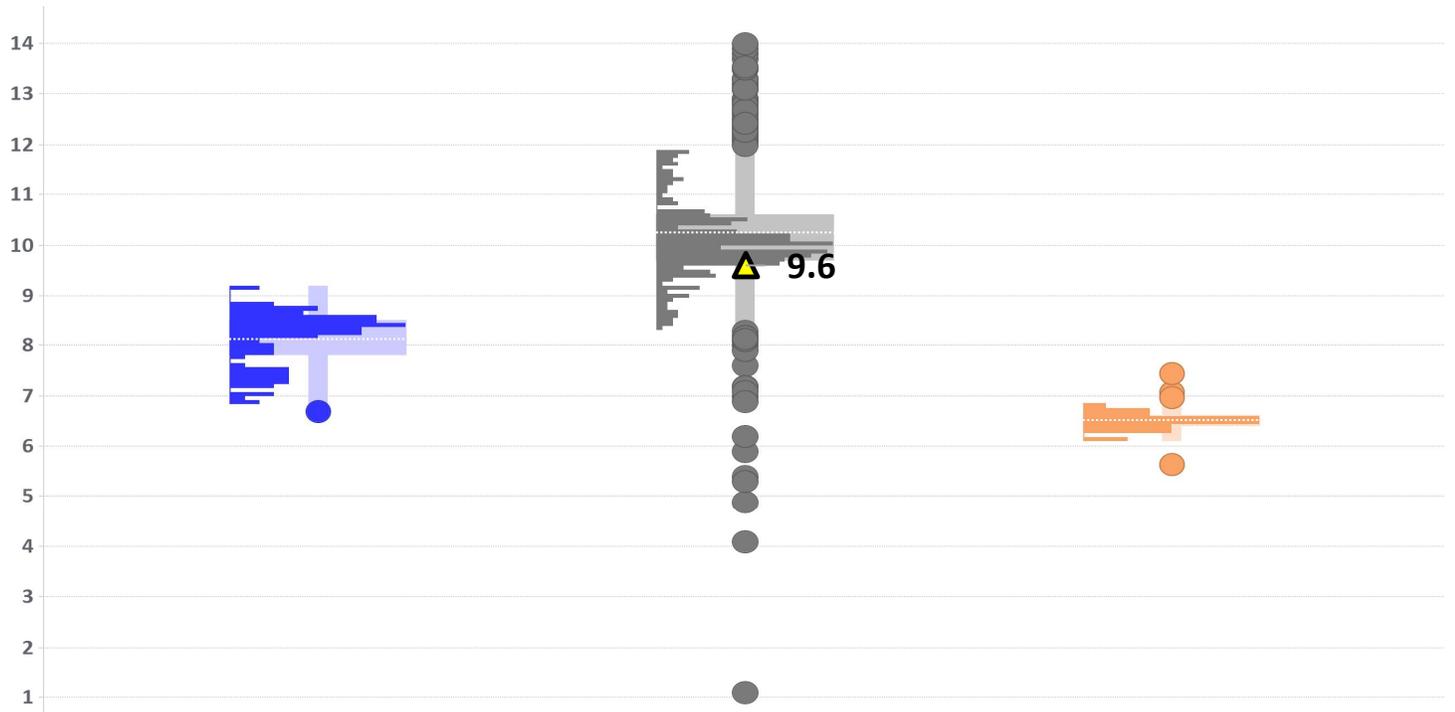

	Baseline Water Quality Aquifer Sample	Bradenhead Water Sample	Production Water Sample
Count	111	470	74
Outliers	1	86	8
Avg	8.13342	10.2491	6.52339

BRADENHEAD WATER SAMPLE OBTAINED 10/22/19 pH 9.6 NOT INDICATIVE OF AQUIFER WATER