


DAVIS P27-6 -- 05-123-15589 -- Aqueous pH Chart

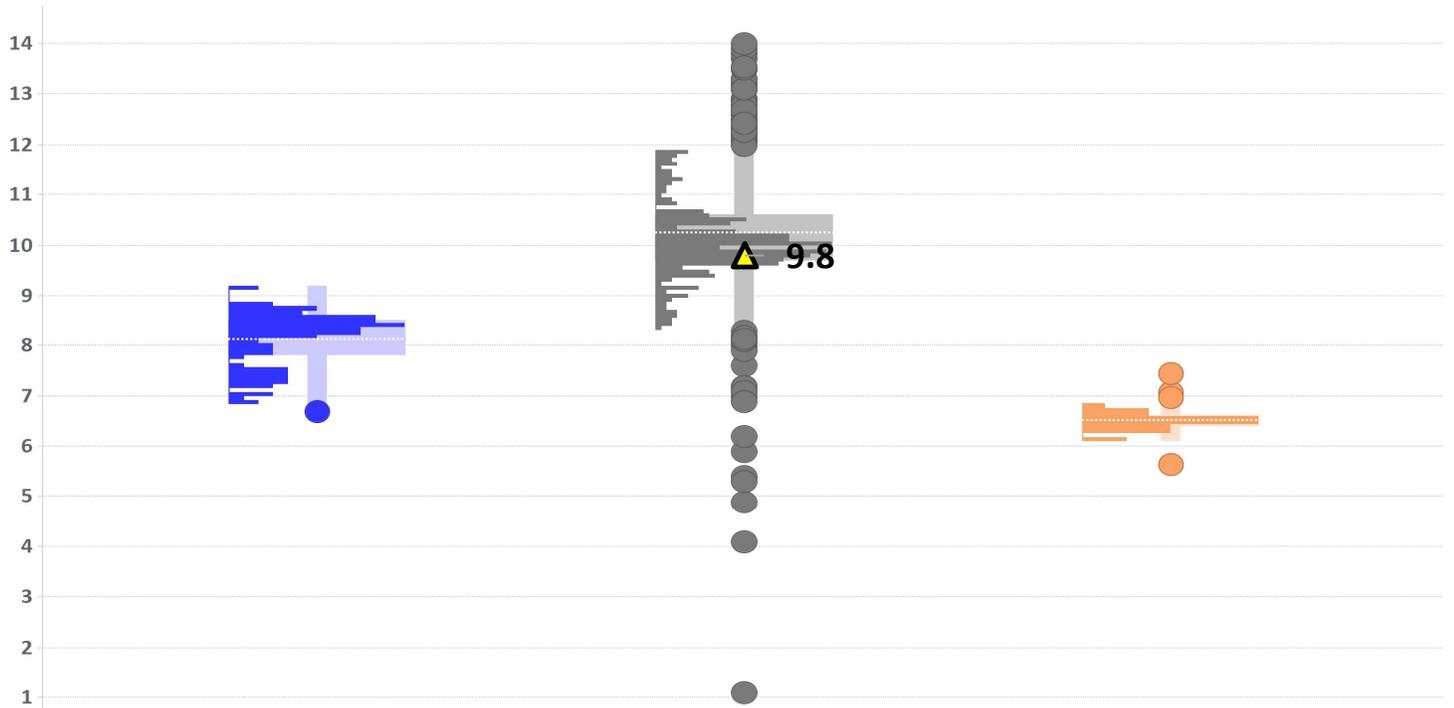

	Baseline Water Quality Aquifer Sample	Bradenhead Water Sample	Production Water Sample
Count	111	470	74
Outliers	1	86	8
Avg	8.13342	10.2491	6.52339

**BRADENHEAD WATER SAMPLE OBTAINED 01/15/20 pH 9.8 NOT INDICATIVE OF AQUIFER WATER**