


MILLER FEDERAL 6-31A -- 05-123-21195 -- Aqueous pH Chart

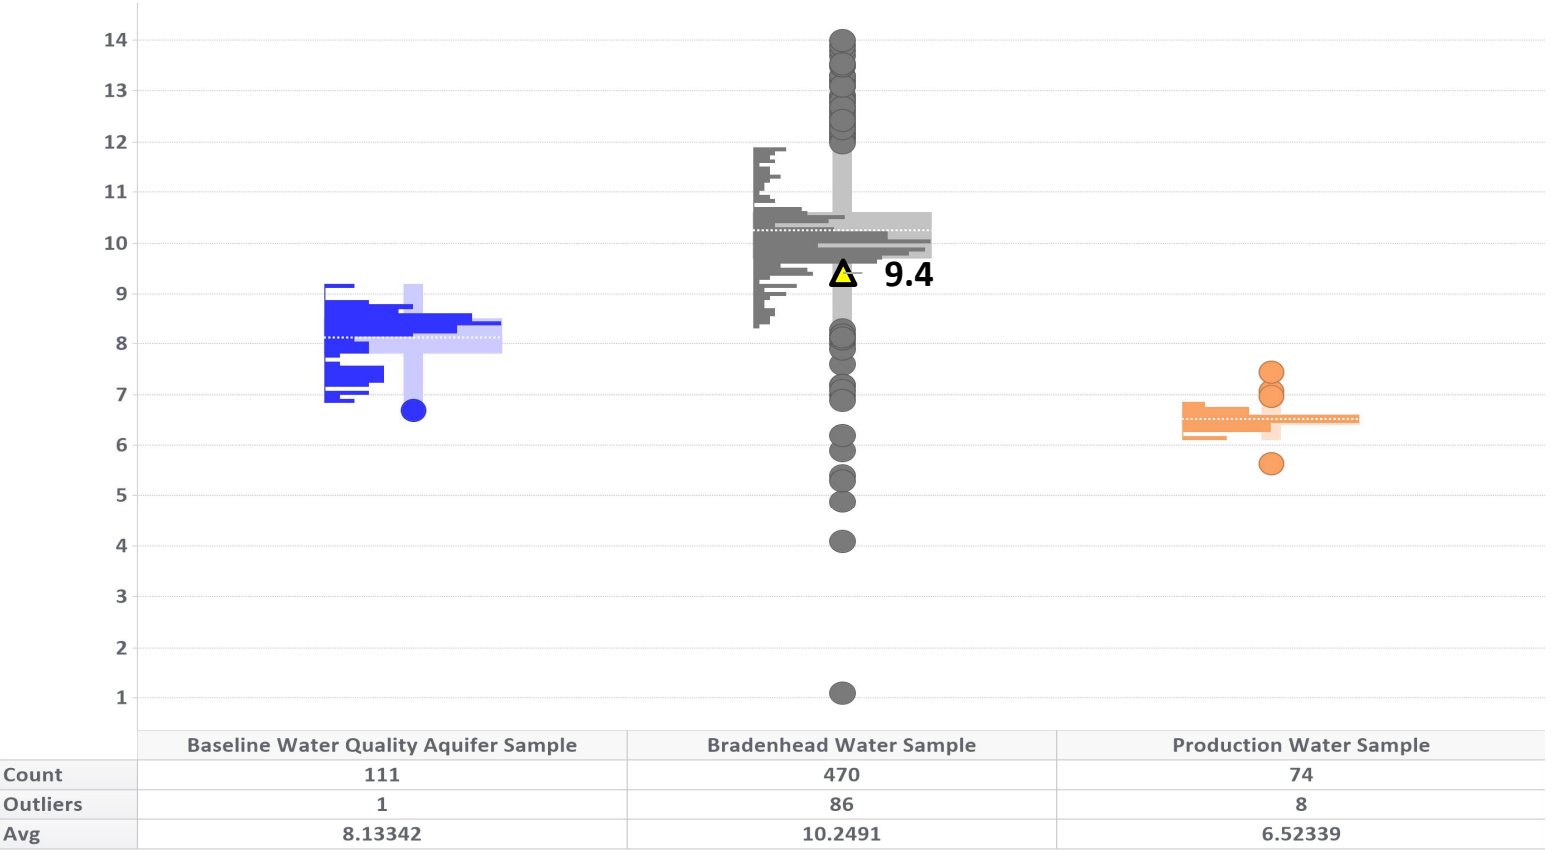

BRADENHEAD WATER SAMPLE OBTAINED 07/11/19 pH 9.41 NOT INDICATIVE OF AQUIFER WATER