


ELVERNA 11-28 -- 05-123-17934 -- Aqueous pH Chart

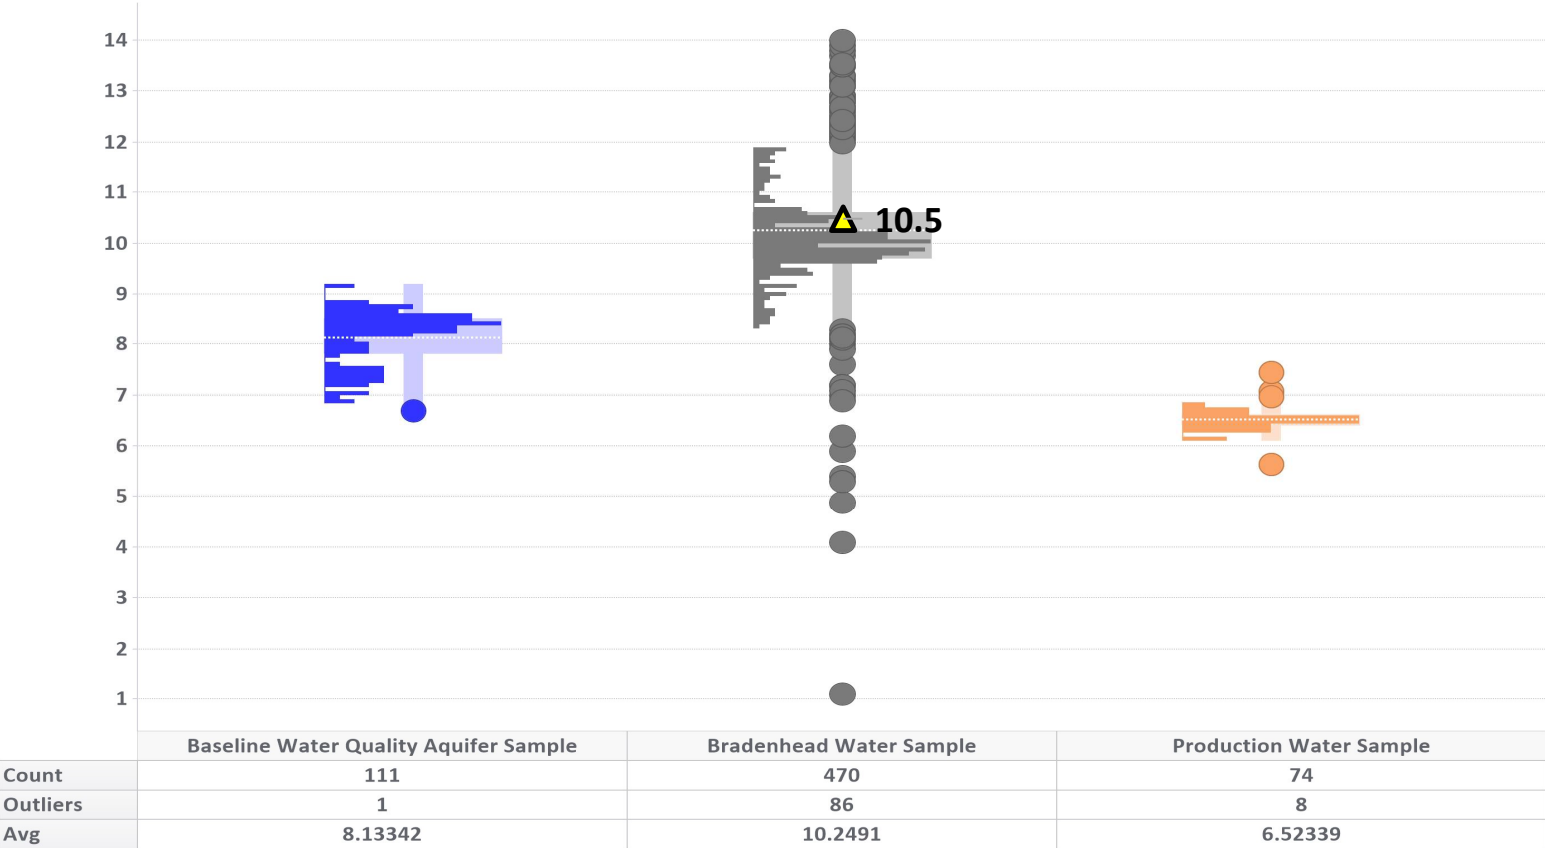

BRADENHEAD WATER SAMPLE OBTAINED 09/09/19 pH 10.5 NOT INDICATIVE OF AQUIFER WATER