


SCOTTDALE RANCH 8-2 -- 05-123-17970 -- Aqueous pH Chart

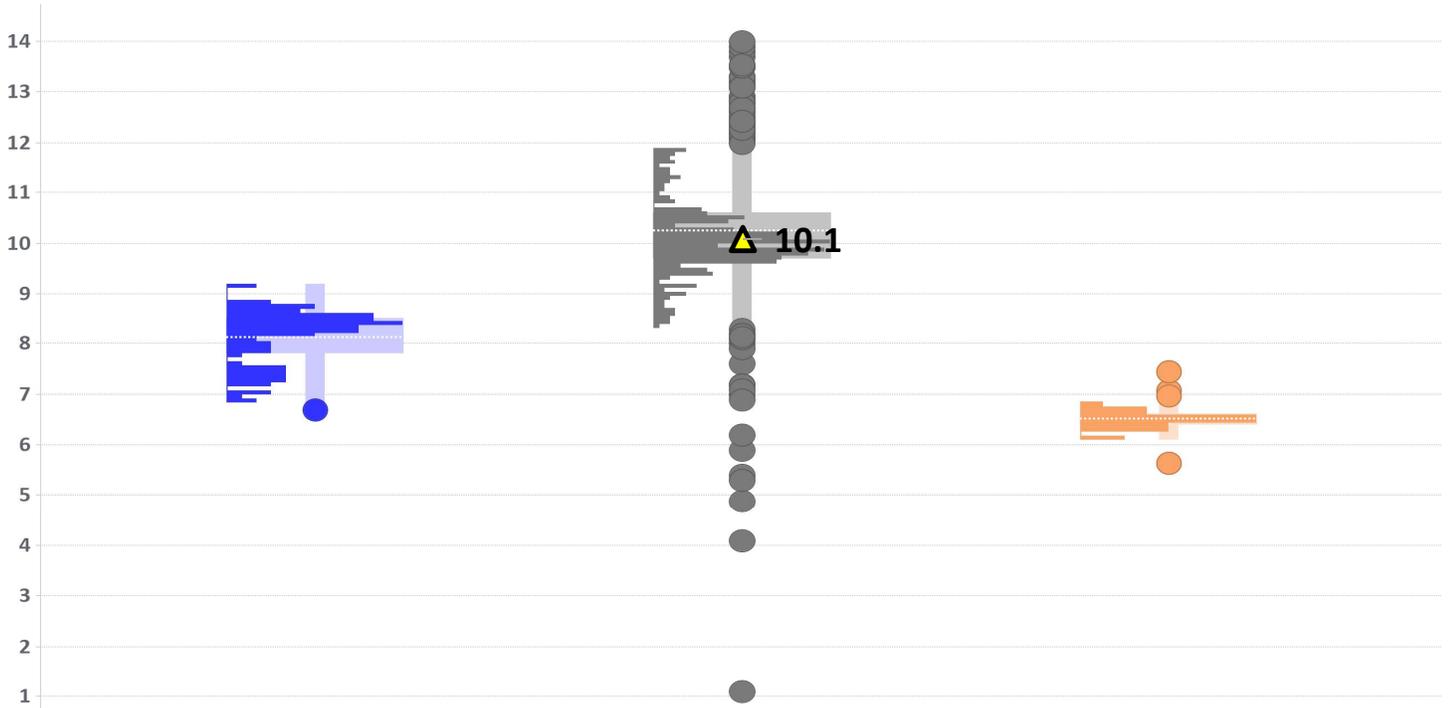

	Baseline Water Quality Aquifer Sample	Bradenhead Water Sample	Production Water Sample
Count	111	470	74
Outliers	1	86	8
Avg	8.13342	10.2491	6.52339

BRADENHEAD WATER SAMPLE OBTAINED 11/20/19 pH 10.1 NOT INDICATIVE OF AQUIFER WATER