


SAKATA 1-35 -- 05-123-22534 -- Aqueous pH Chart

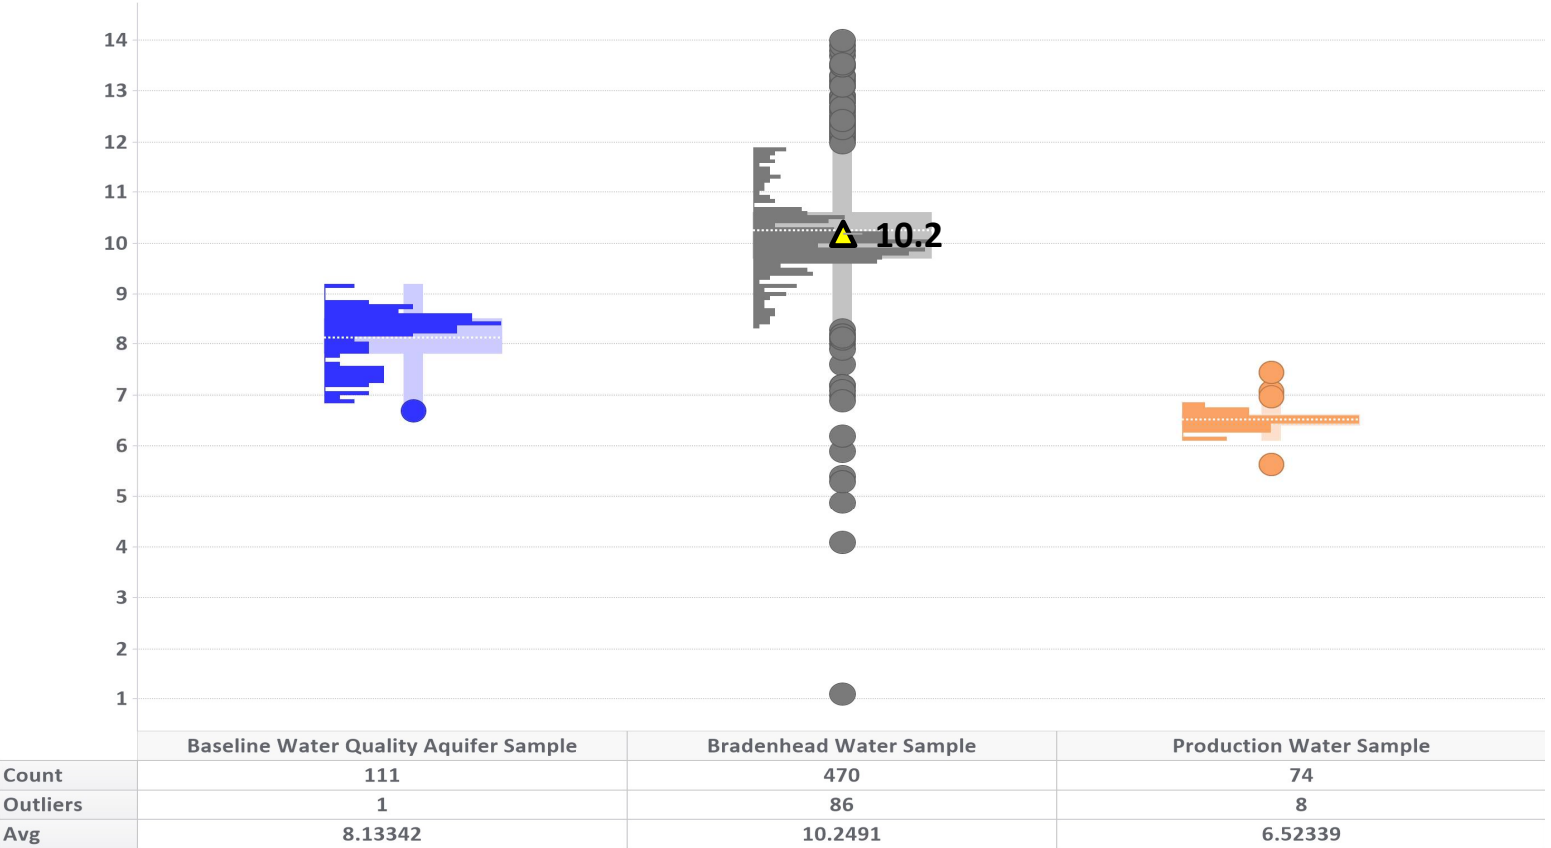

BRADENHEAD WATER SAMPLE OBTAINED 08/19/19 pH 10.2 NOT INDICATIVE OF AQUIFER WATER