


BALDWIN 6-11 -- 05-123-22106 -- Aqueous pH Chart

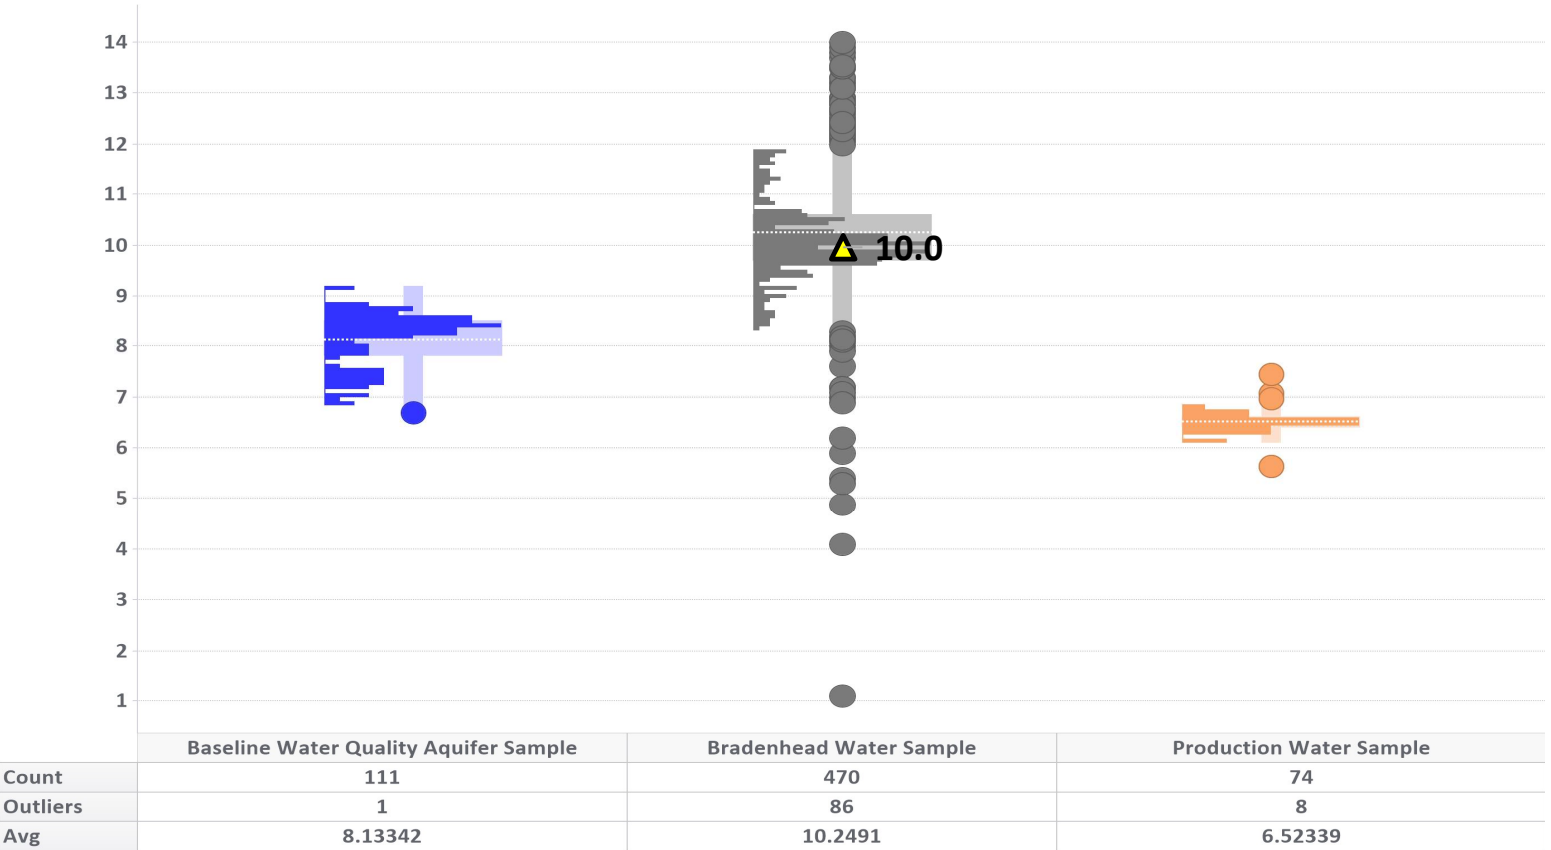

BRADENHEAD WATER SAMPLE OBTAINED 01/08/20 pH 9.97 NOT INDICATIVE OF AQUIFER WATER