


HSR-WADDELL 12-24 -- 05-123-17484 -- Aqueous pH Chart

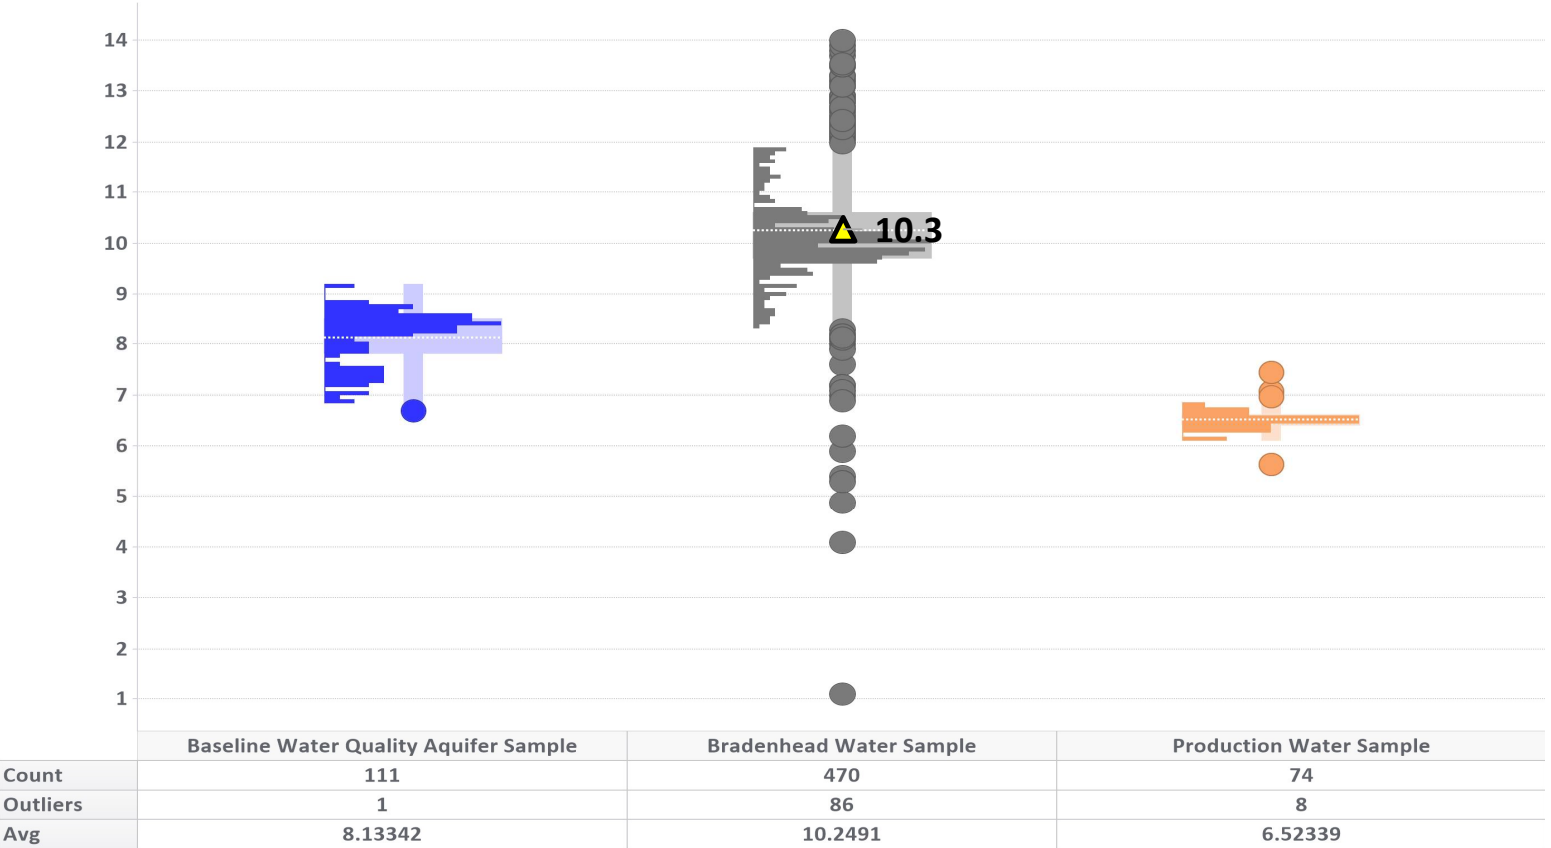

BRADENHEAD WATER SAMPLE OBTAINED 08/03/20 pH 10.29 NOT INDICATIVE OF AQUIFER WATER