


SALAZAR P20-25 -- 05-123-22316 -- Aqueous pH Chart

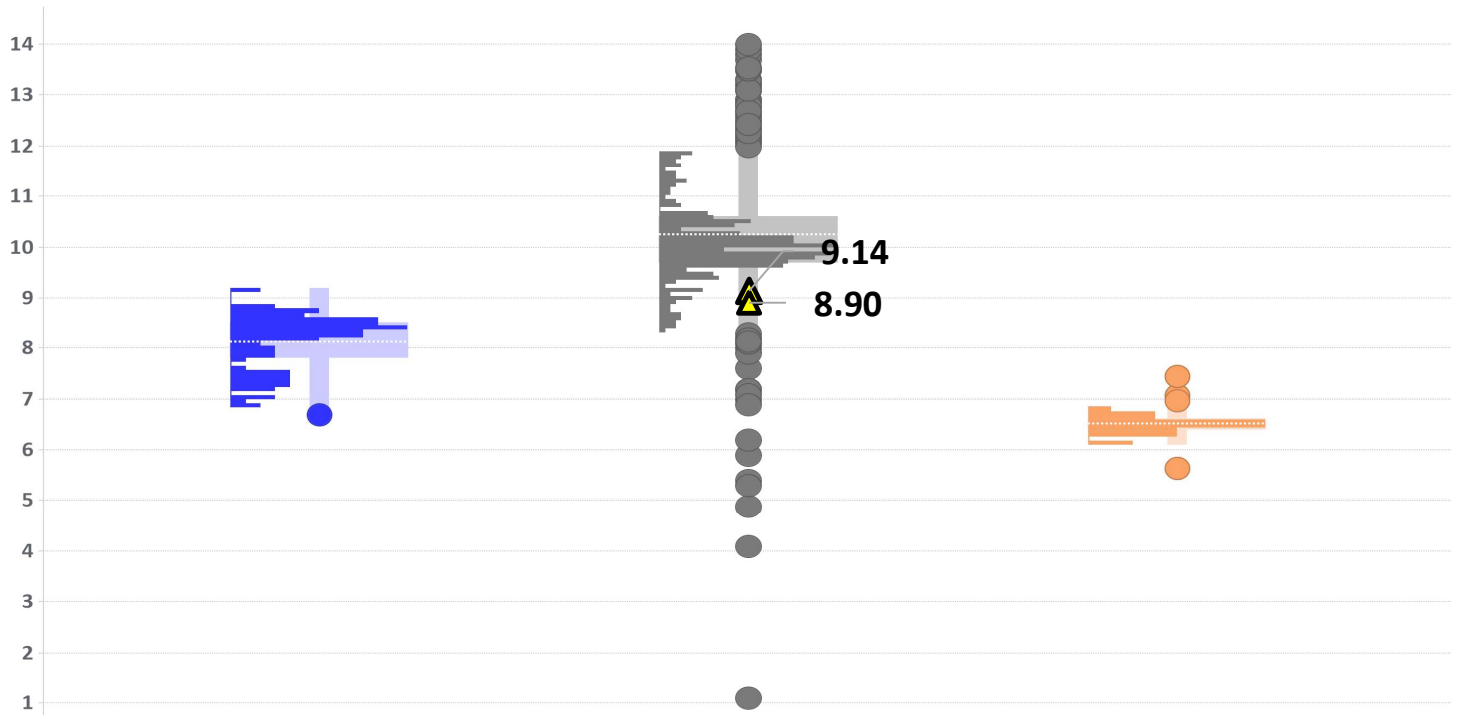

	Baseline Water Quality Aquifer Sample	Bradenhead Water Sample	Production Water Sample
Count	111	470	74
Outliers	1	86	8
Avg	8.13342	10.2491	6.52339

BRADENHEAD WATER SAMPLE OBTAINED 11/18/20, 08/03/20 pH 9.14, 8.9, RESPECTIVELY