


HSR-ACCORD 16-30 -- 05-123-19118 -- Aqueous pH Chart

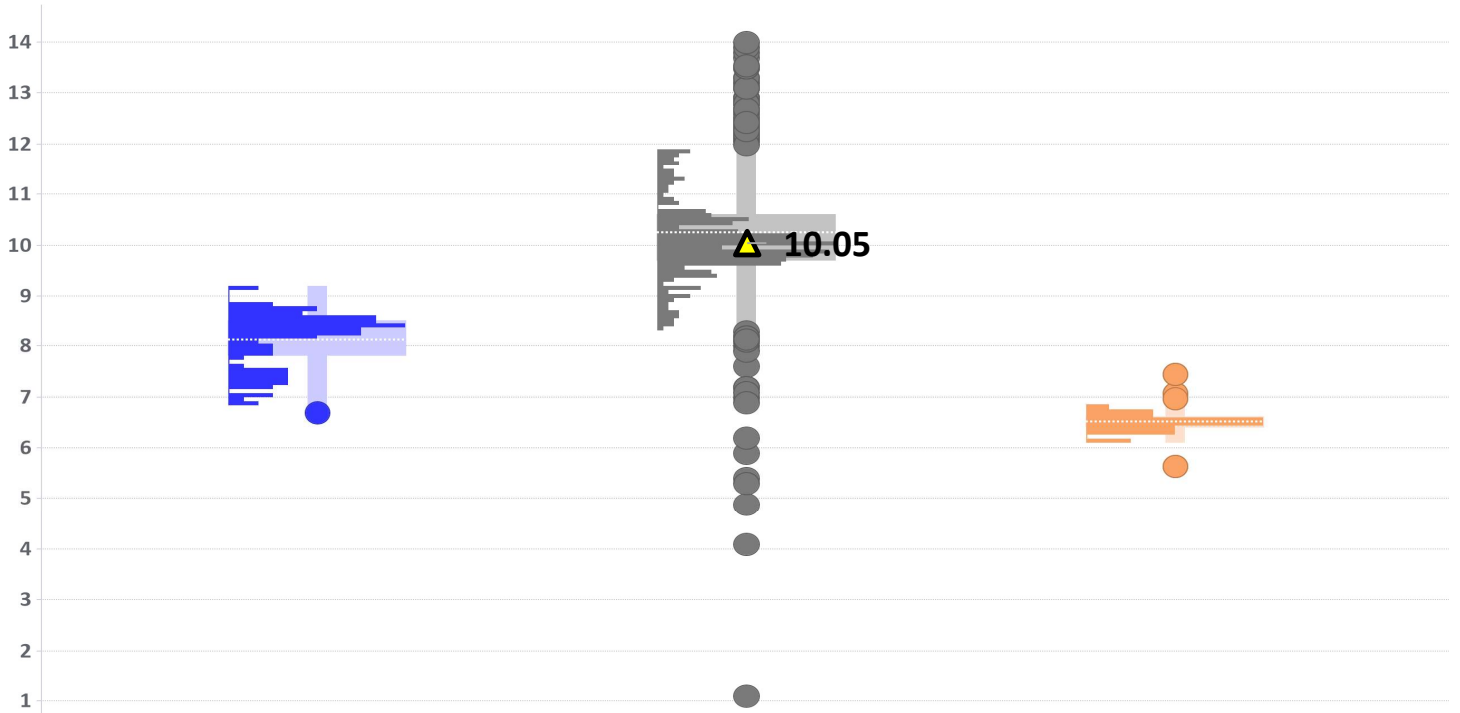

	Baseline Water Quality Aquifer Sample	Bradenhead Water Sample	Production Water Sample
Count	111	470	74
Outliers	1	86	8
Avg	8.13342	10.2491	6.52339

BRADENHEAD WATER SAMPLE OBTAINED 01/23/20 pH 10.05