


THOMPSON 6-33 -- 05-123-20646 -- Aqueous pH Chart

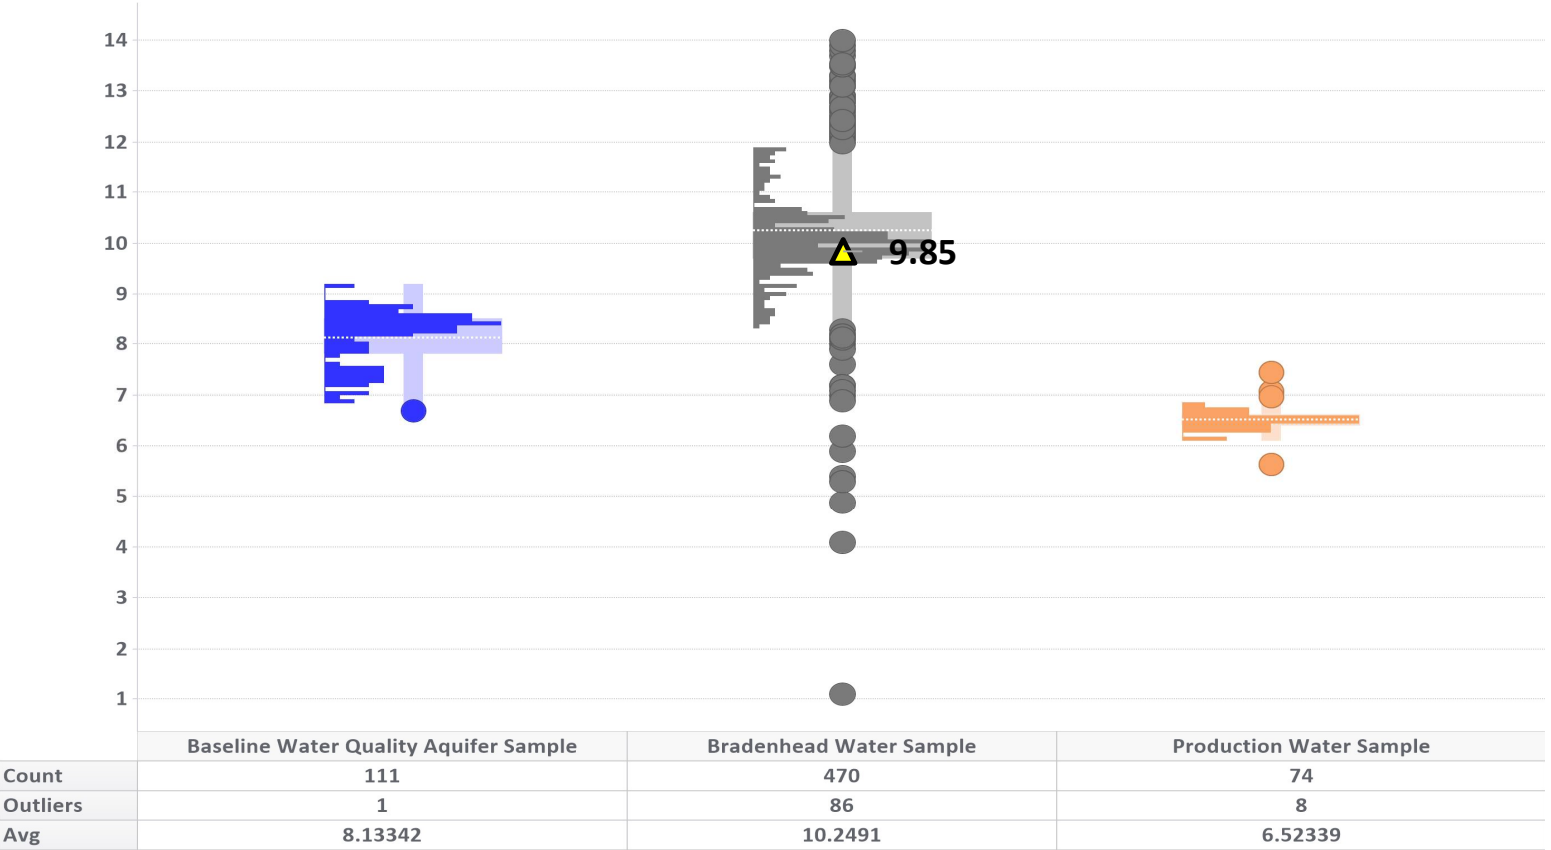

BRADENHEAD WATER SAMPLE OBTAINED 09/11/19 pH 9.85