


HSR-BEDDO 6-25 -- 05-123-19540 -- Aqueous pH Chart

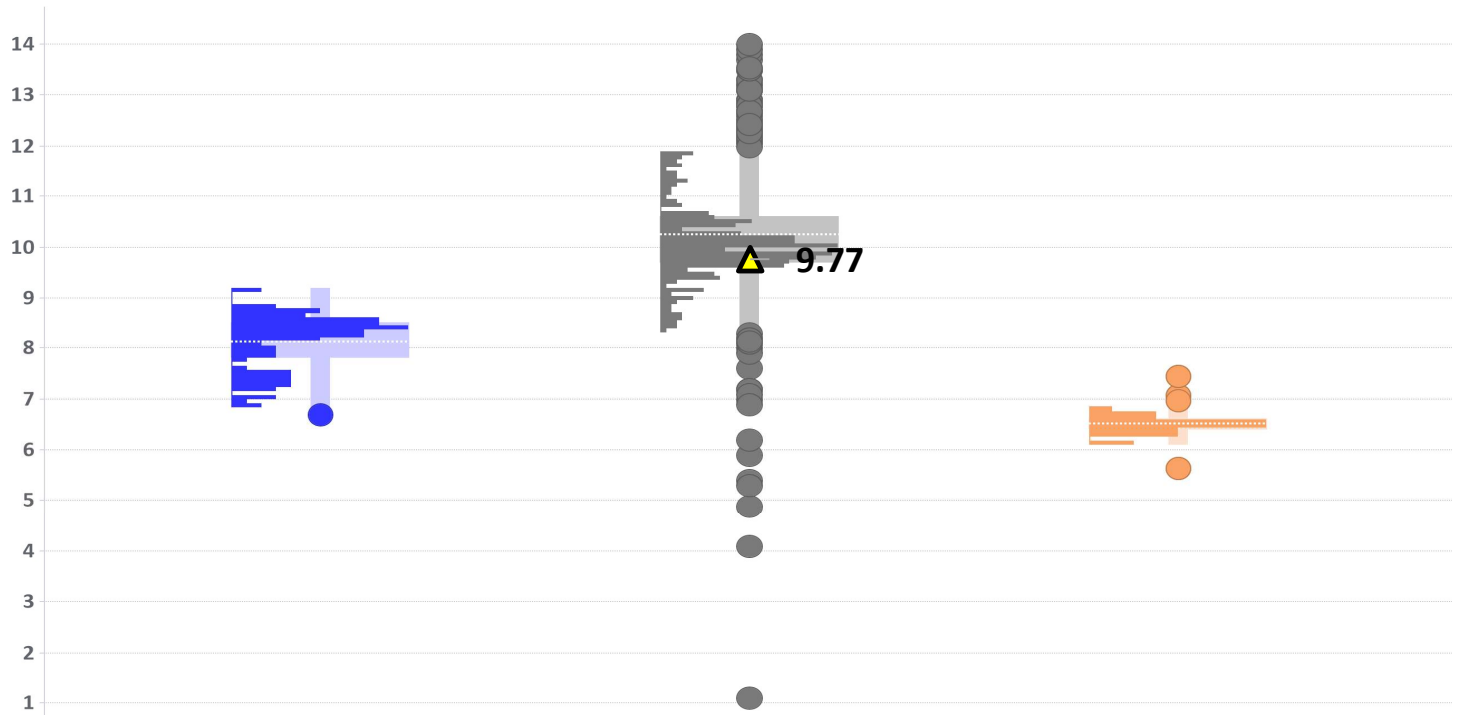

BRADENHEAD WATER SAMPLE OBTAINED 02/04/20 pH 9.77