


STRONG P21-22 -- 05-123-22589 -- Aqueous pH Chart

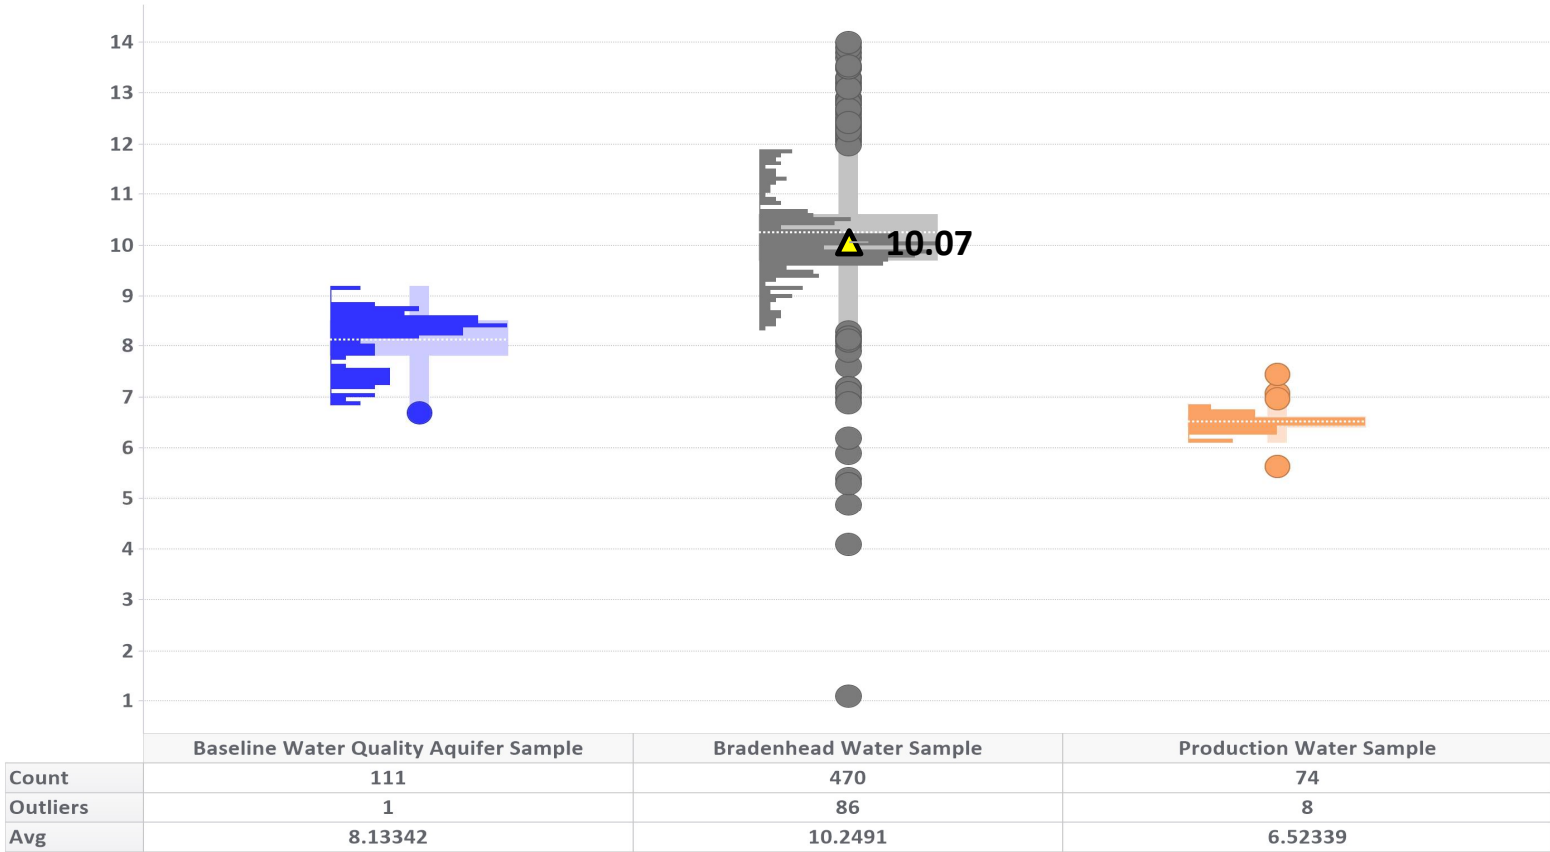

BRADENHEAD WATER SAMPLE OBTAINED 01/21/20 pH 10.07