


LOVELAND 2-3 -- 05-123-23191 -- Aqueous pH Chart

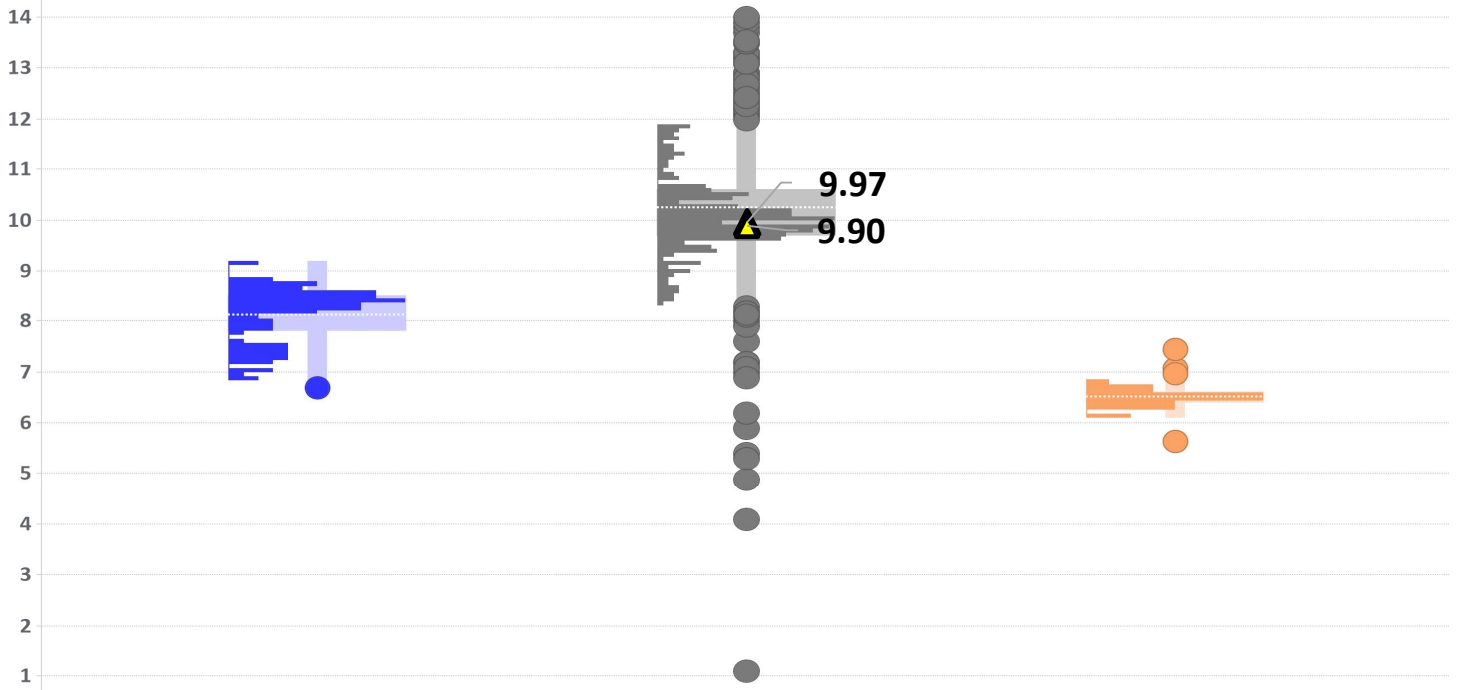

	Baseline Water Quality Aquifer Sample	Bradenhead Water Sample	Production Water Sample
Count	111	470	74
Outliers	1	86	8
Avg	8.13342	10.2491	6.52339

BRADENHEAD WATER SAMPLE OBTAINED 10/15/20, 08/15/19 pH 9.97, 9.9, RESPECTIVELY