


SWANK 41-11 -- 05-123-18722 -- Aqueous pH Chart

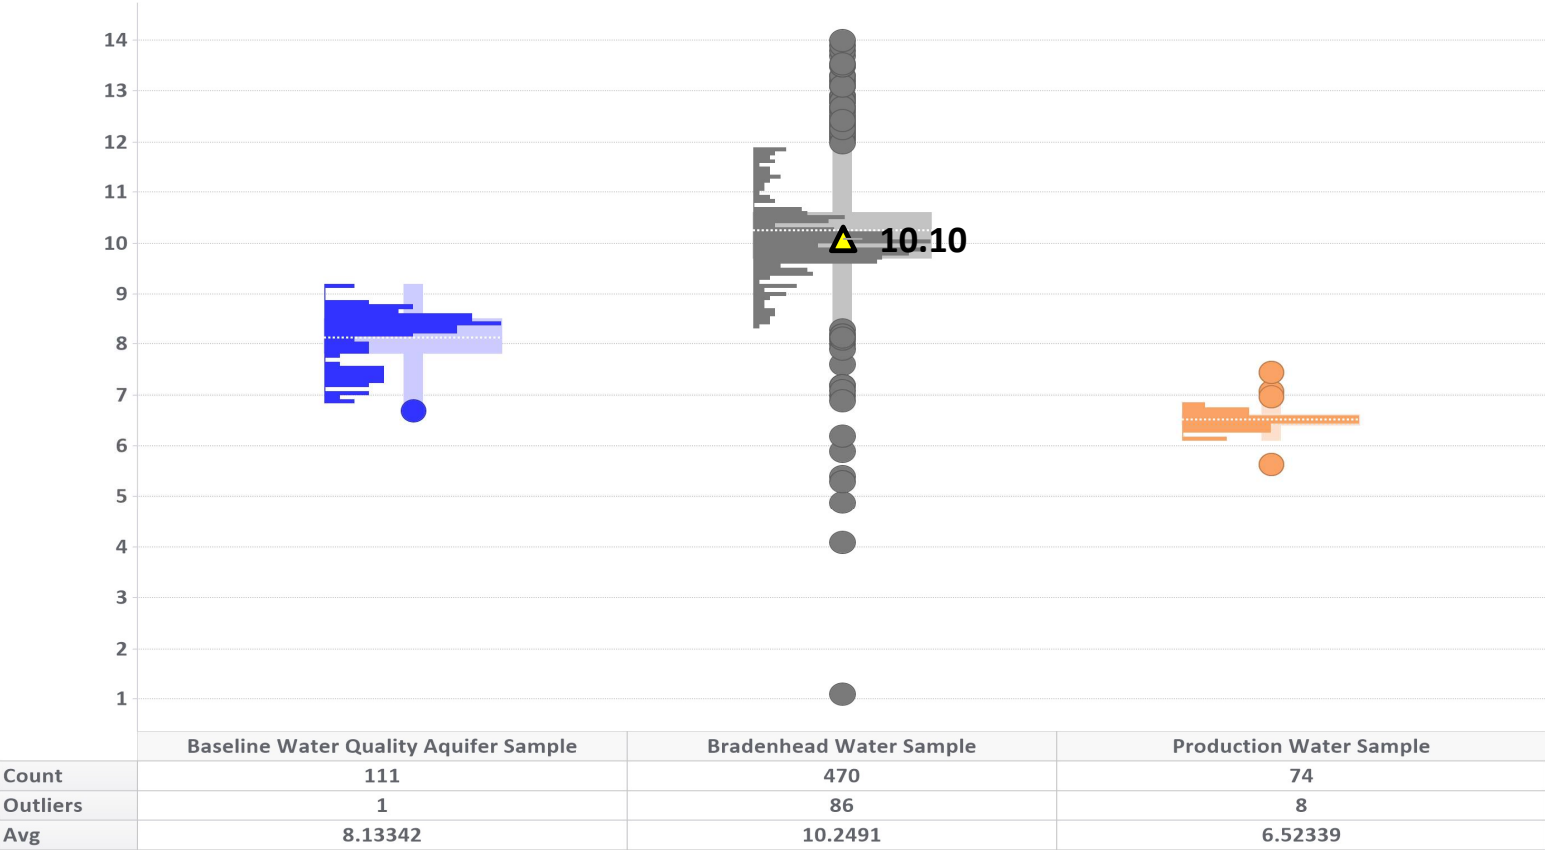

BRADENHEAD WATER SAMPLE OBTAINED 10/23/19 pH 10.10