Stable Isotope Interpretive Plots

Methane vs Gas Wetness Genetic Classification

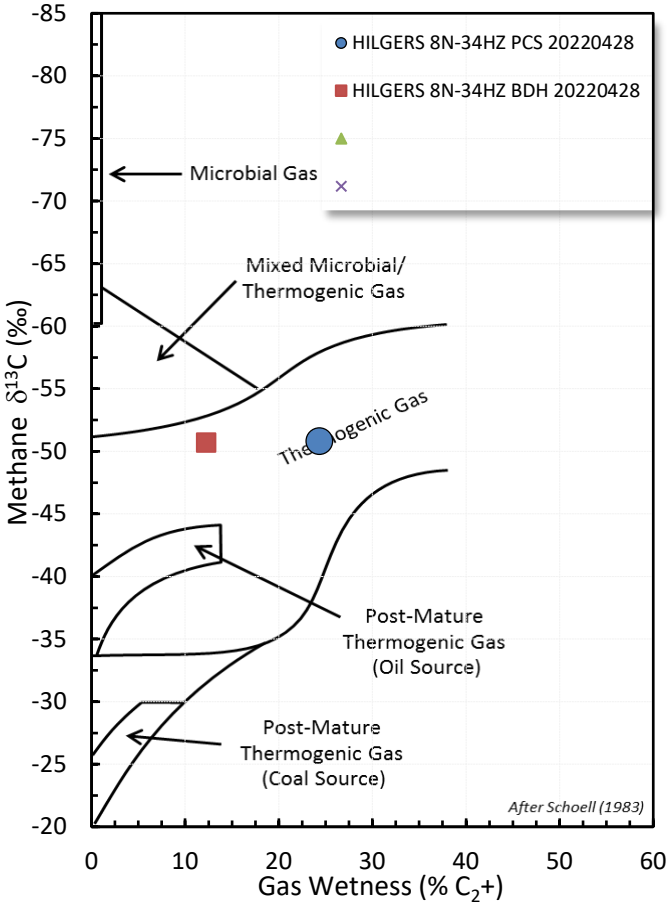

Methane $\delta^{13}C$ vs δD Genetic Classification Plot

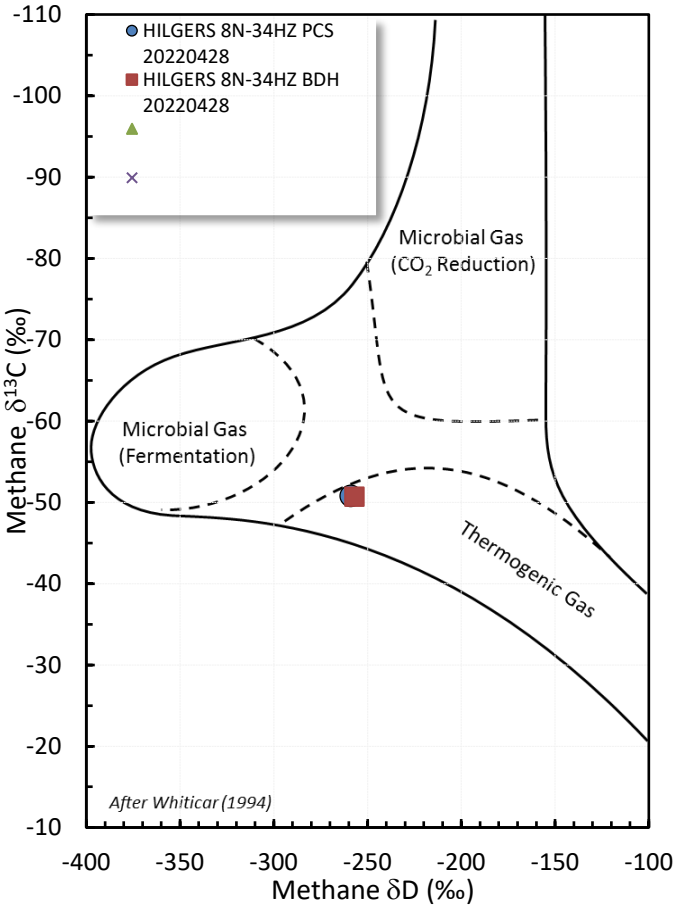

Methane $\delta^{13}C$ vs $C_1/(C_2+C_3)$ Genetic Classification Plot

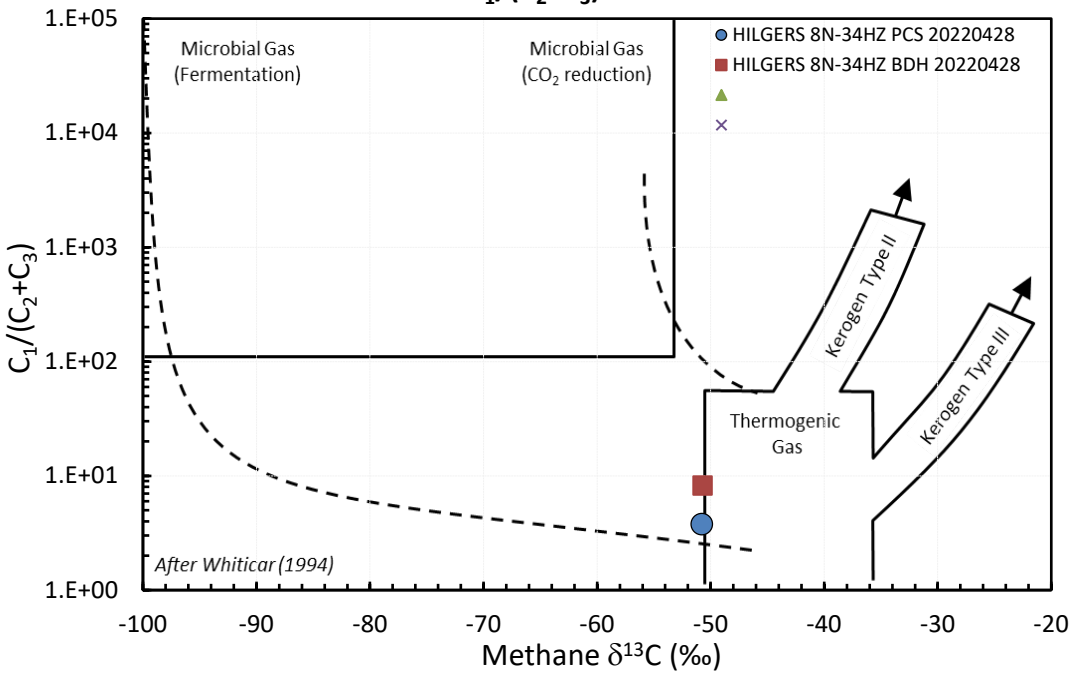

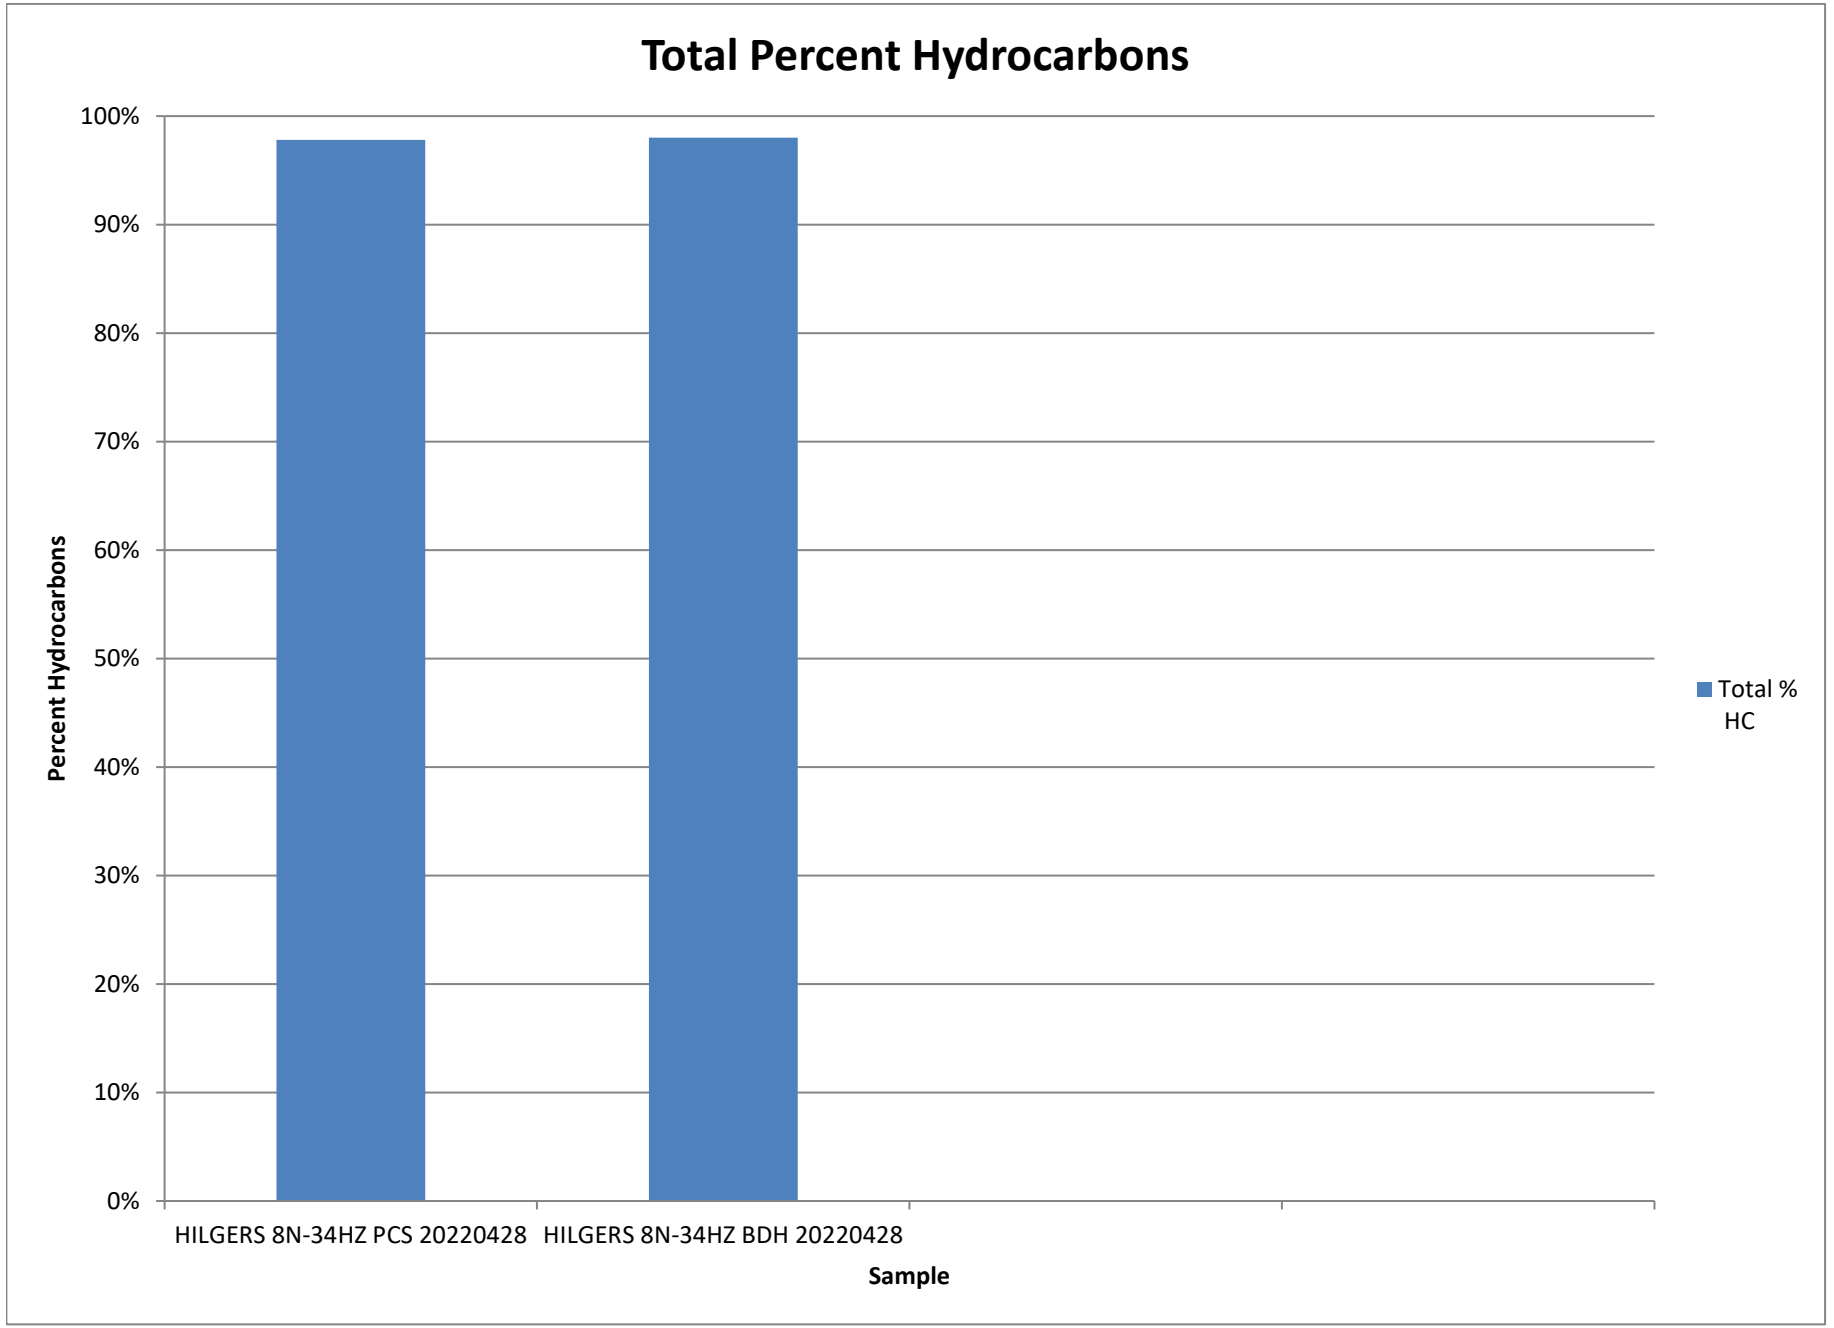
Total Percent Hydrocarbons
100%
90%
80%
70%
60%
50%
40%
30%
20%
10%
0%
Percent Hydrocarbons
HILGERS 8N-34HZ PCS 20220428
HILGERS 8N-34HZ BDH 20220428
Sample
Total % HC

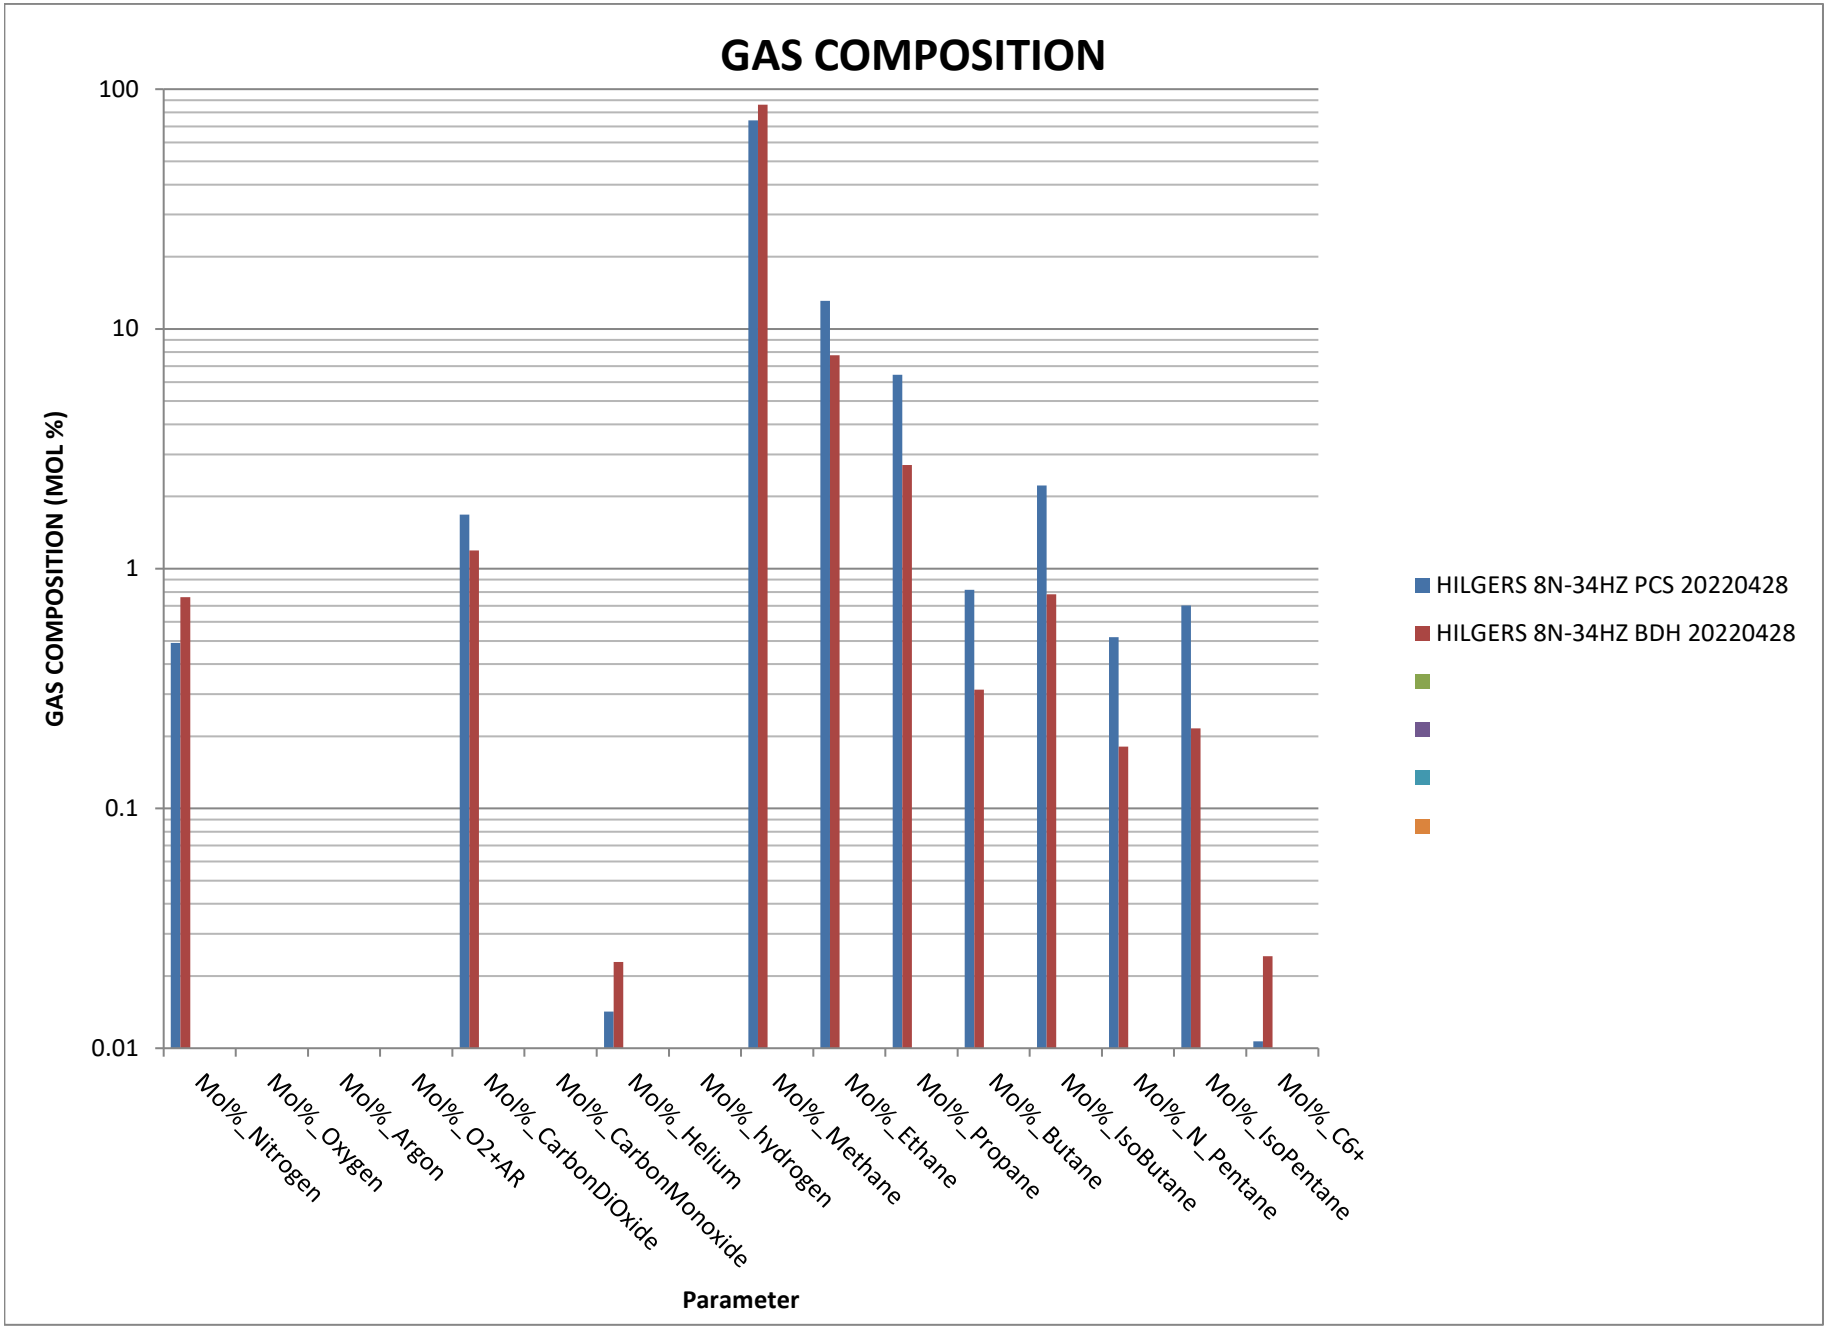
GAS COMPOSITION
100
10
1
0.1
0.01
GAS COMPOSITION (MOL %)
Mol%_Nitrogen
Mol%_Oxygen
Mol%_Argon
Mol%_O2+AR
Mol%_CarbonDiOxide
Mol%_CarbonMonoxide
Mol%_Helium
Mol%_hydrogen
Mol%_Methane
Mol%_Ethane
Mol%_Propane
Mol%_Butane
Mol%_IsoButane
Mol%_N_Pentane
Mol%_IsoPentane
Mol%_C6+
Parameter
HILGERS 8N-34HZ PCS 20220428
HILGERS 8N-34HZ BDH 20220428

HYDROCARBON COMPOSITION

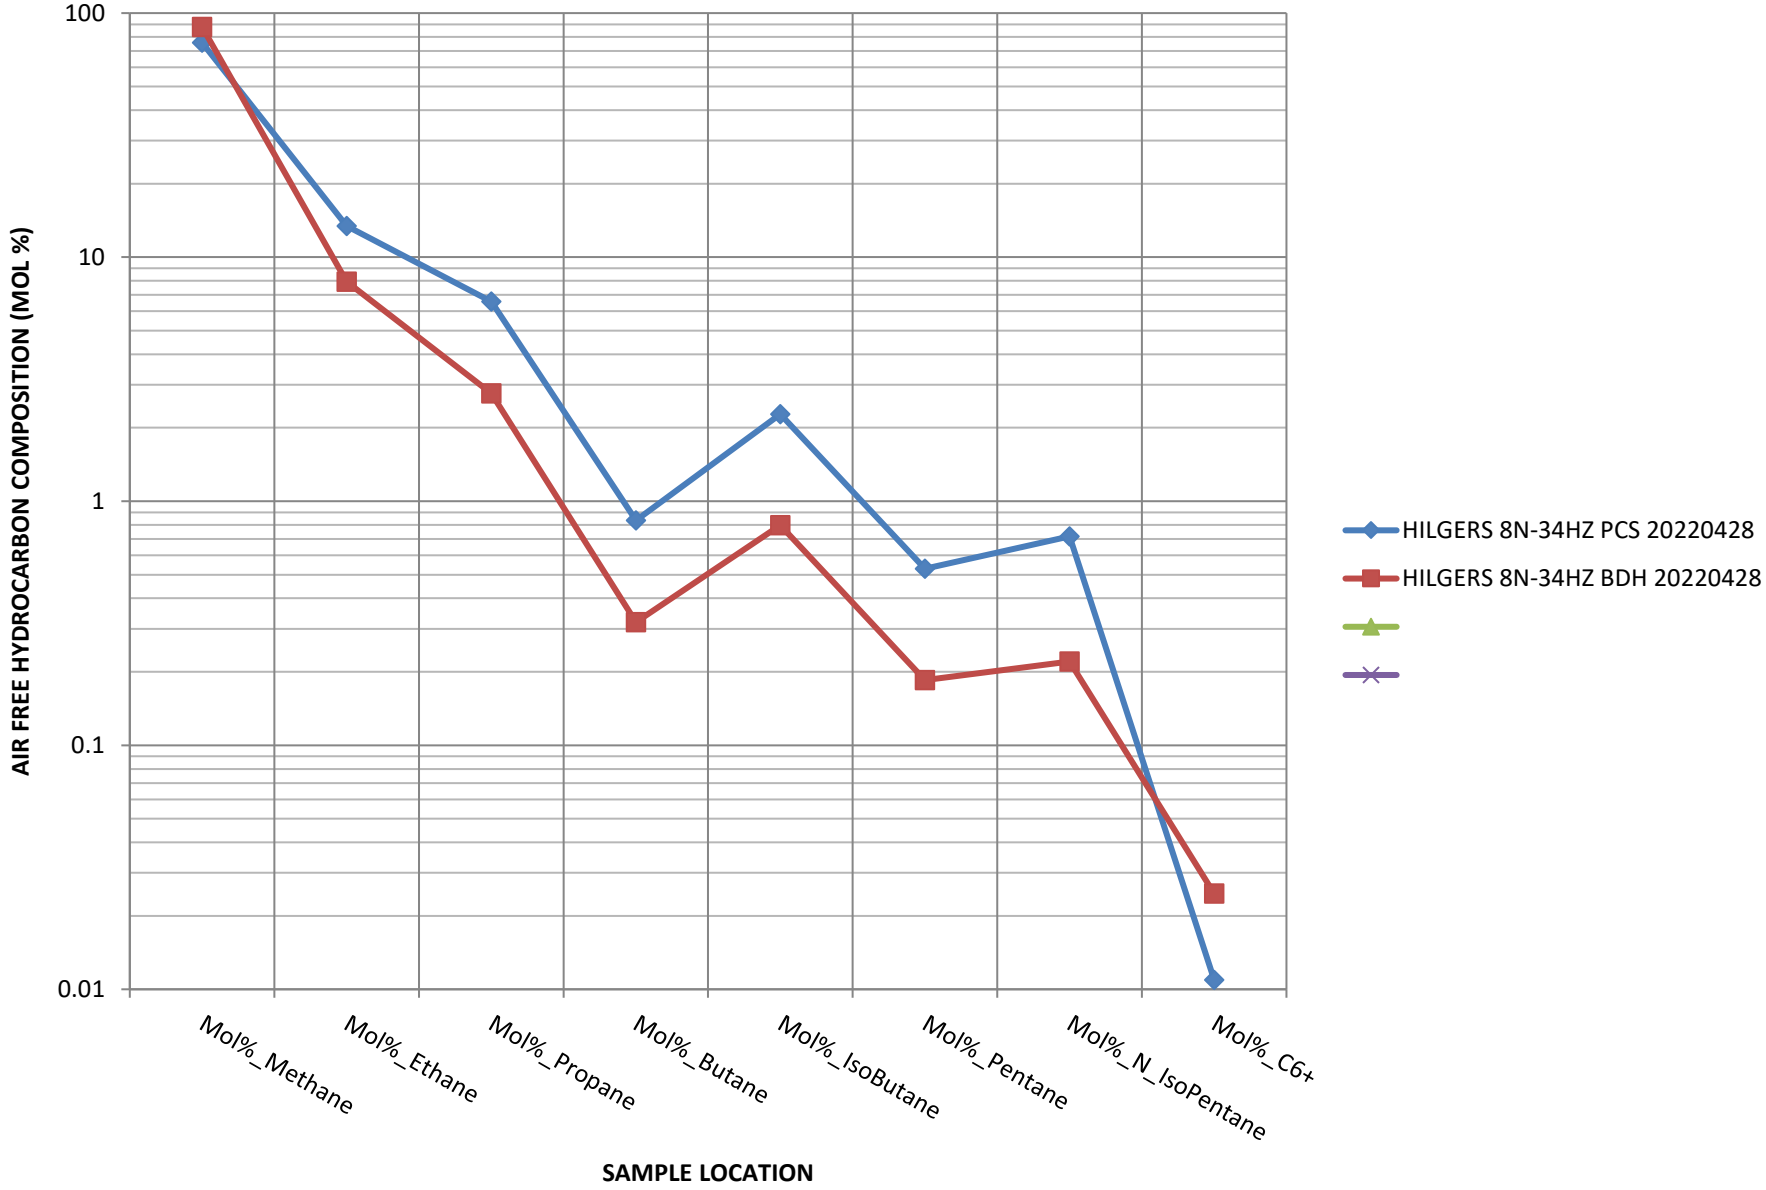

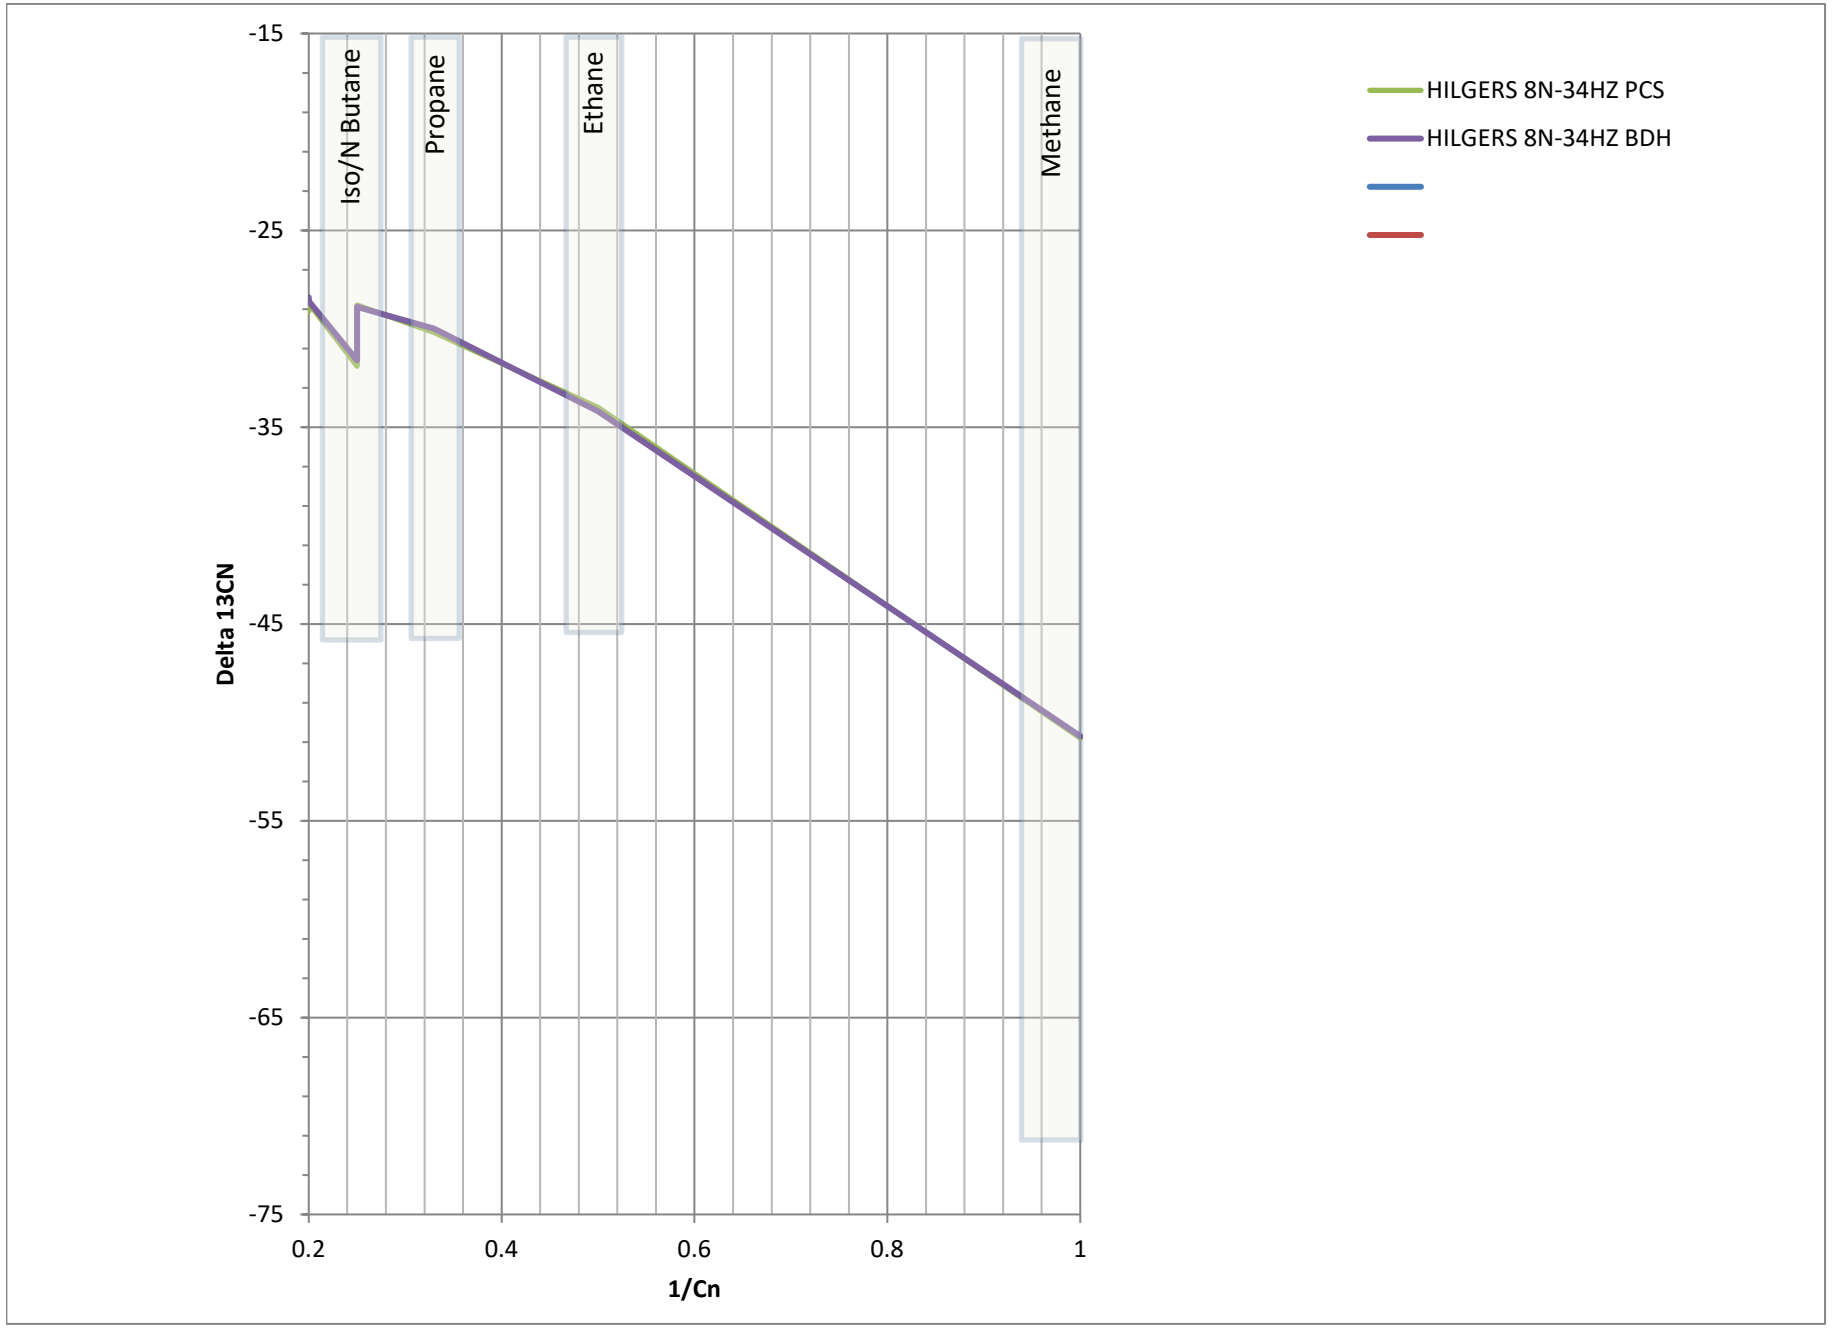
-15
-25
-35
-45
-55
-65
-75
Delta 13CN
0.2
0.4
0.6
0.8
1
1/Cn
Iso/N Butane
Propane
Ethane
Methane
HILGERS 8N-34HZ PCS
HILGERS 8N-34HZ BDH

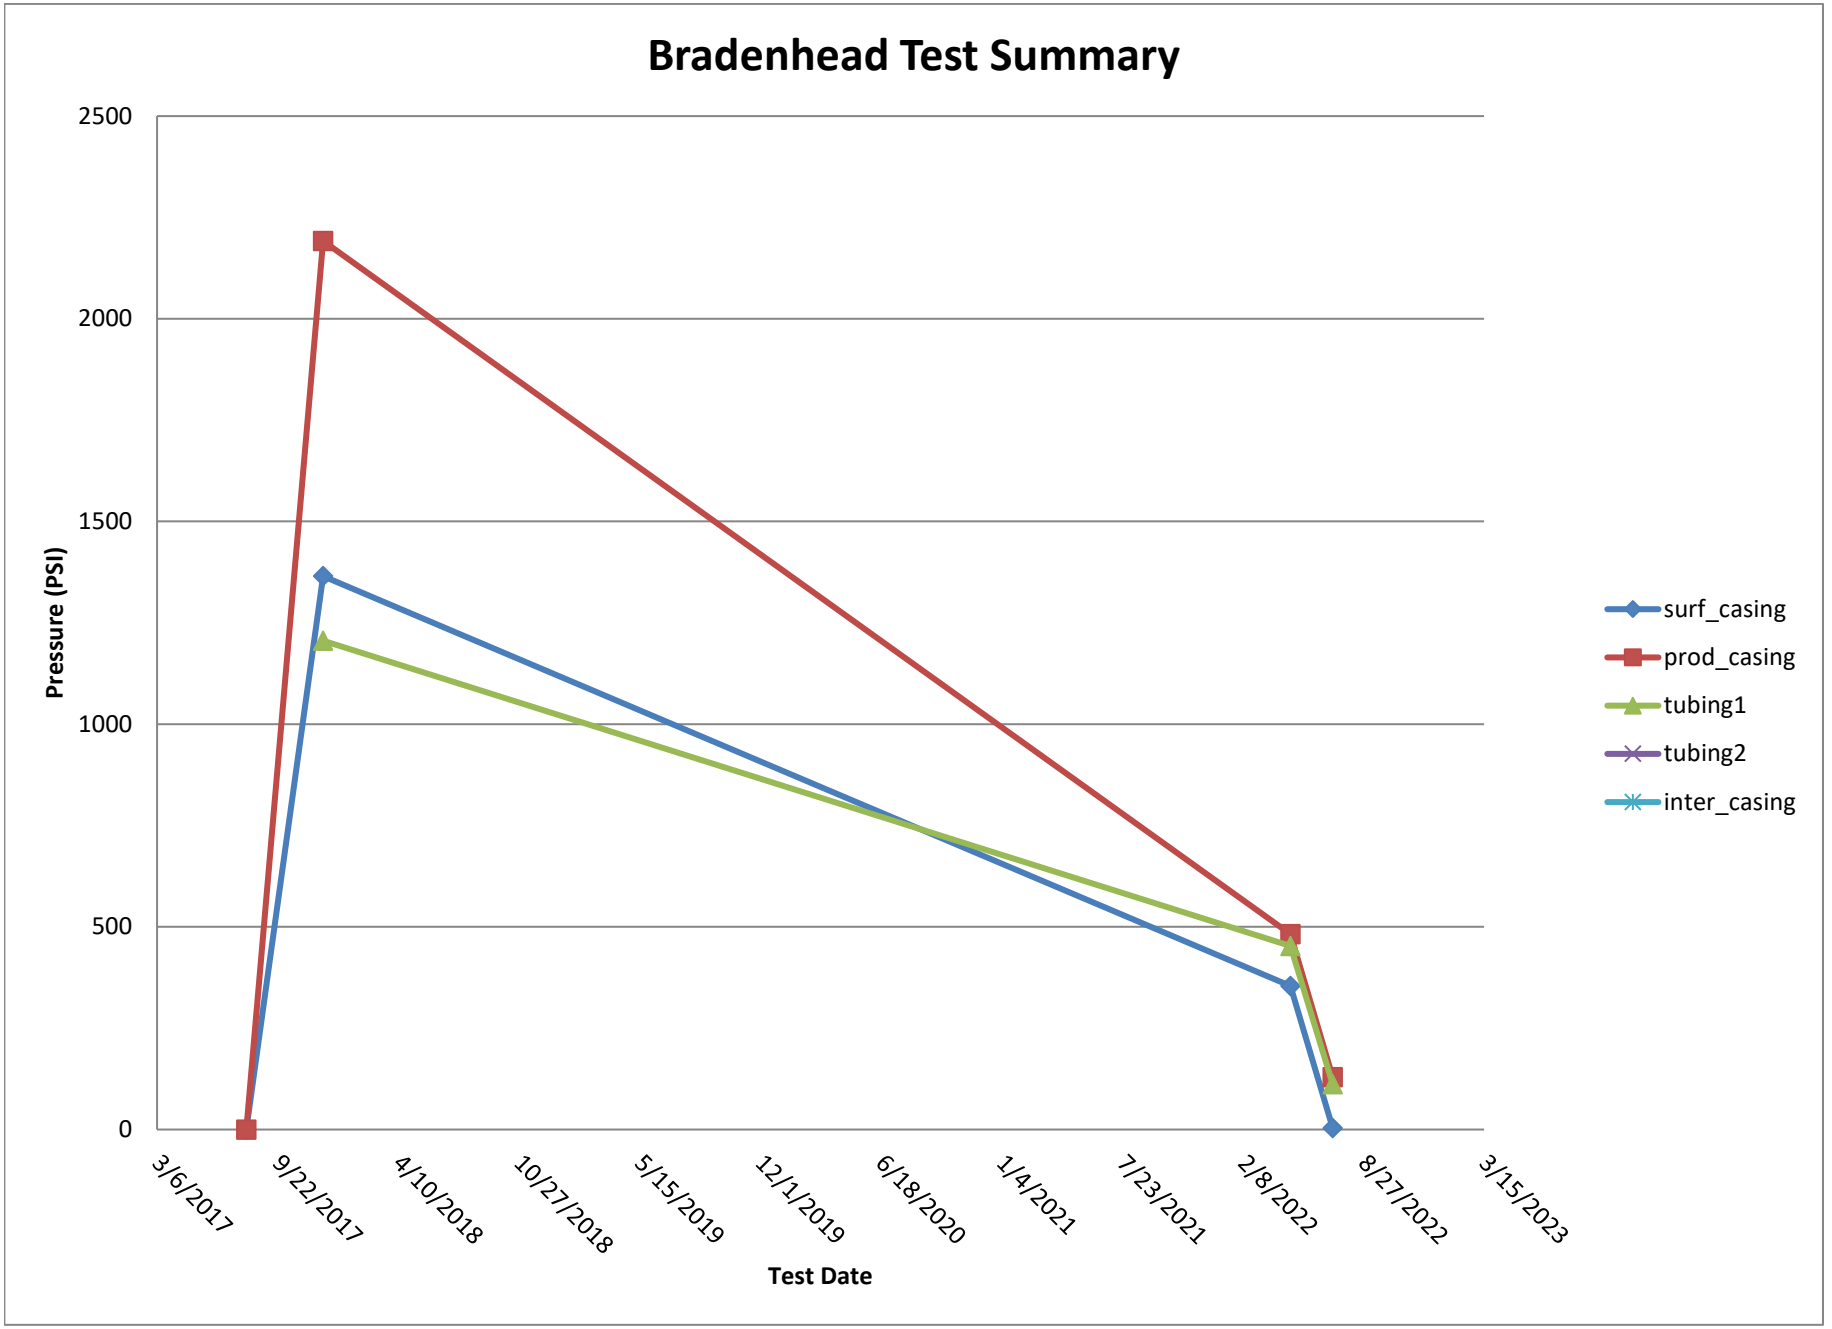
Bradenhead Test Summary
2500
2000
1500
1000
500
0
Pressure (PSI)
3/6/2017
9/22/2017
4/10/2018
10/27/2018
5/15/2019
12/1/2019
6/18/2020
1/4/2021
7/23/2021
2/8/2022
8/27/2022
3/15/2023
Test Date
surf_casing
prod_casing
tubing1
tubing2
inter_casing

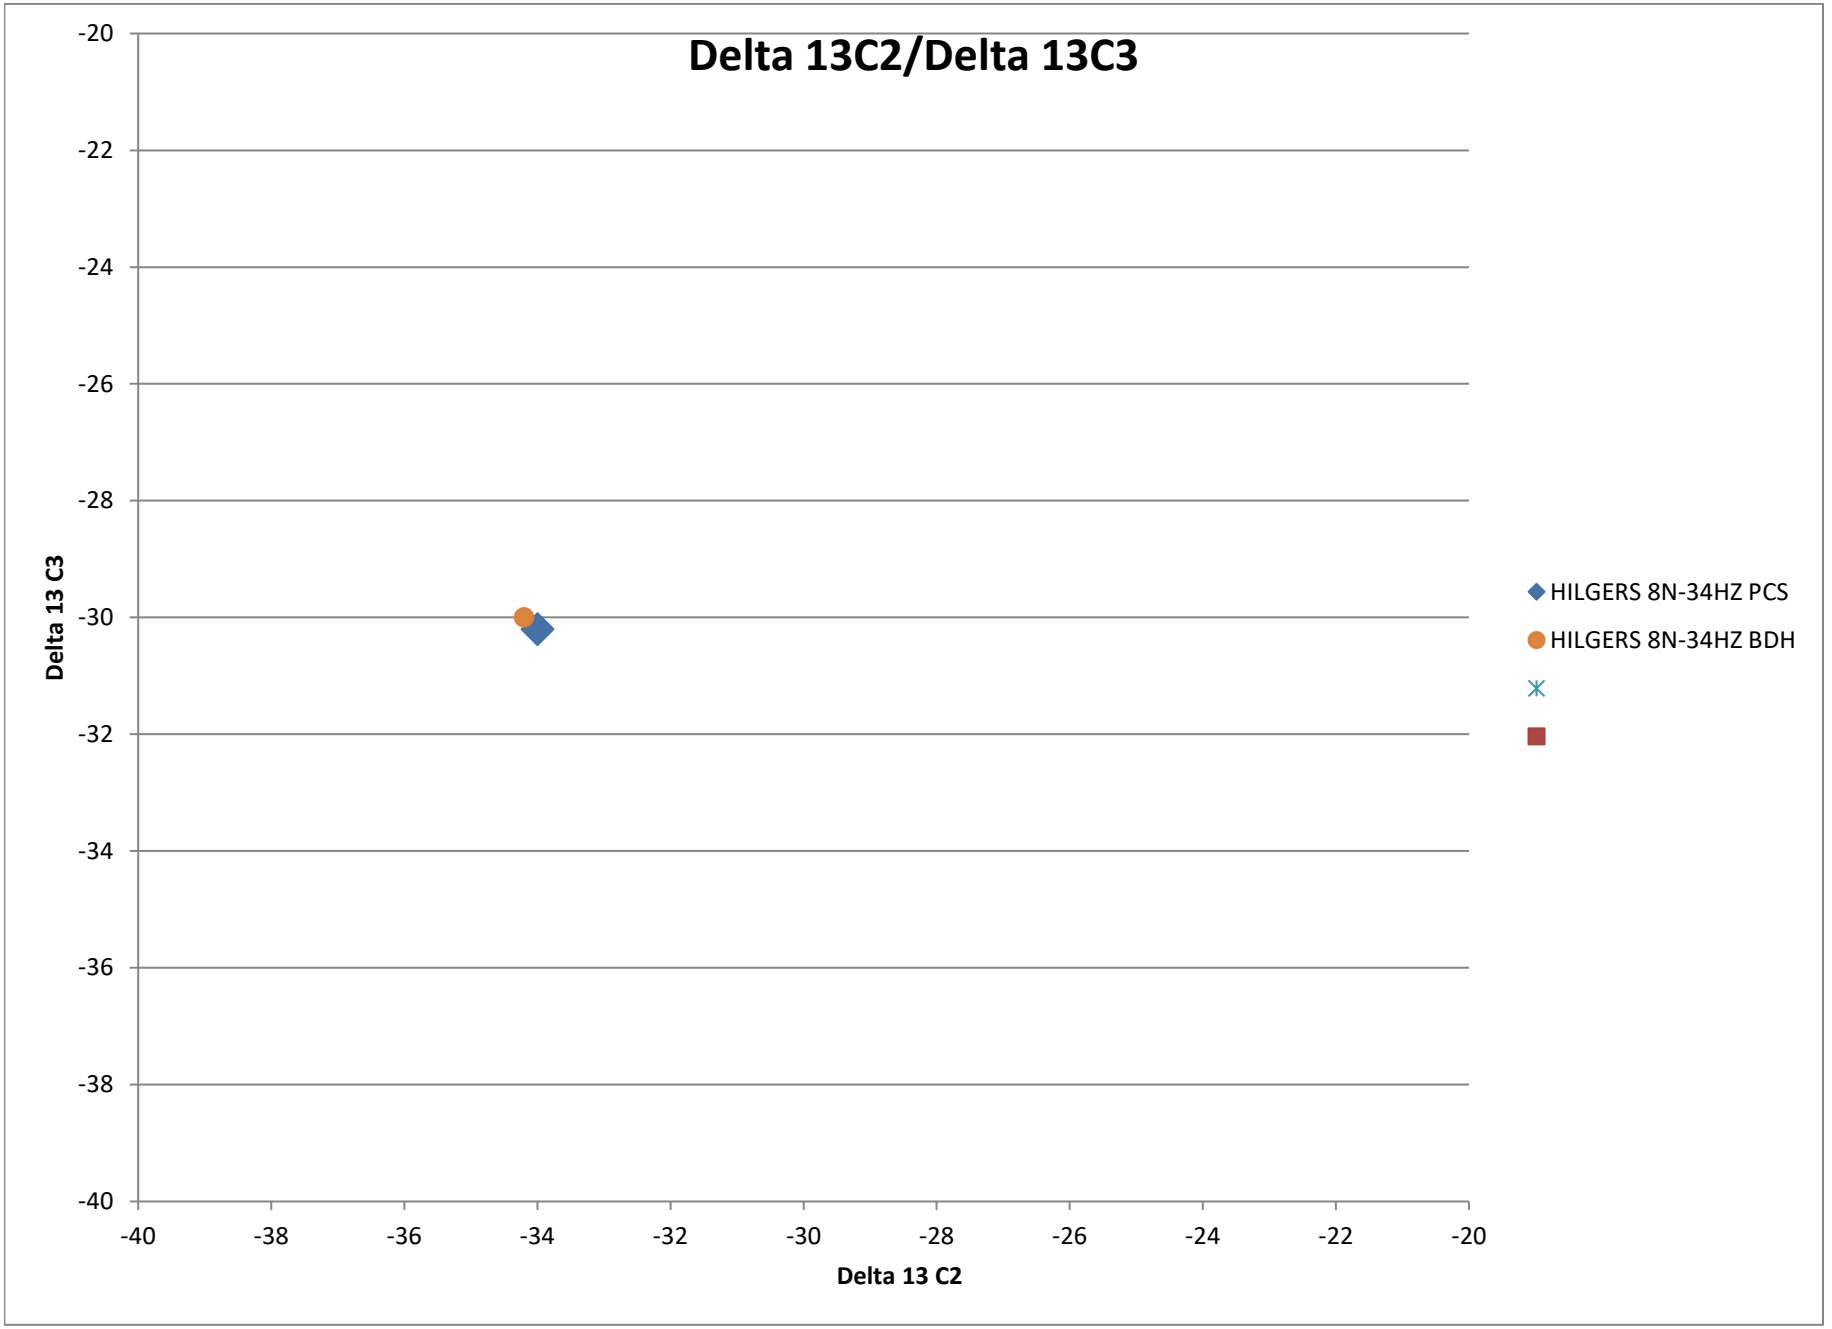
Delta 13C2/Delta 13C3
-20
-22
-24
-26
-28
-30
-32
-34
-36
-38
-40
Delta 13 C3
-40
-38
-36
-34
-32
-30
-28
-26
-24
-22
-20
Delta 13 C2
HILGERS 8N-34HZ PCS
HILGERS 8N-34HZ BDH

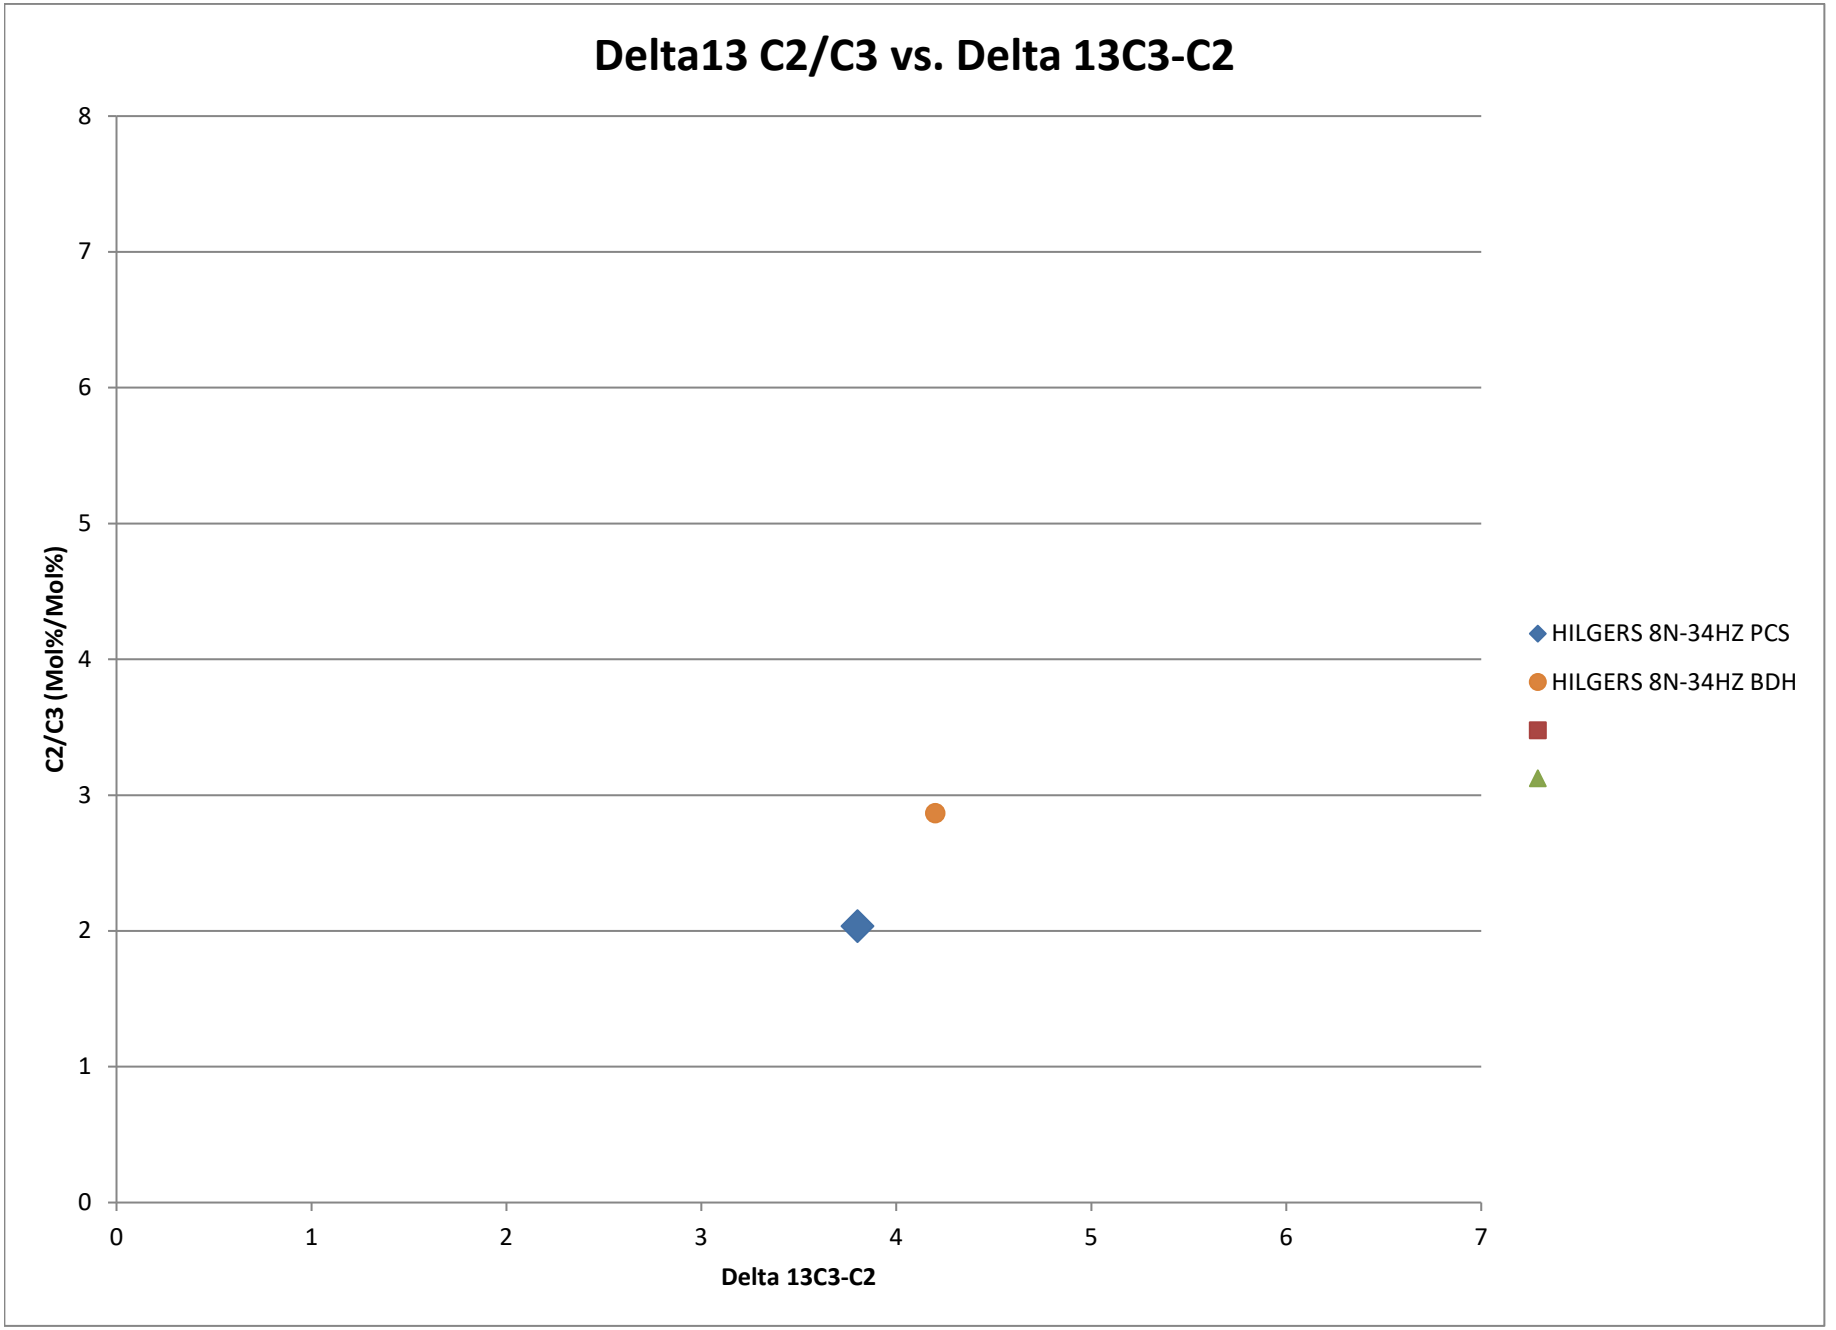
Delta13 C2/C3 vs. Delta 13C3-C2
C2/C3 (Mol%/Mol%)
Delta 13C3-C2
0
1
2
3
4
5
6
7
8
HILGERS 8N-34HZ PCS
HILGERS 8N-34HZ BDH

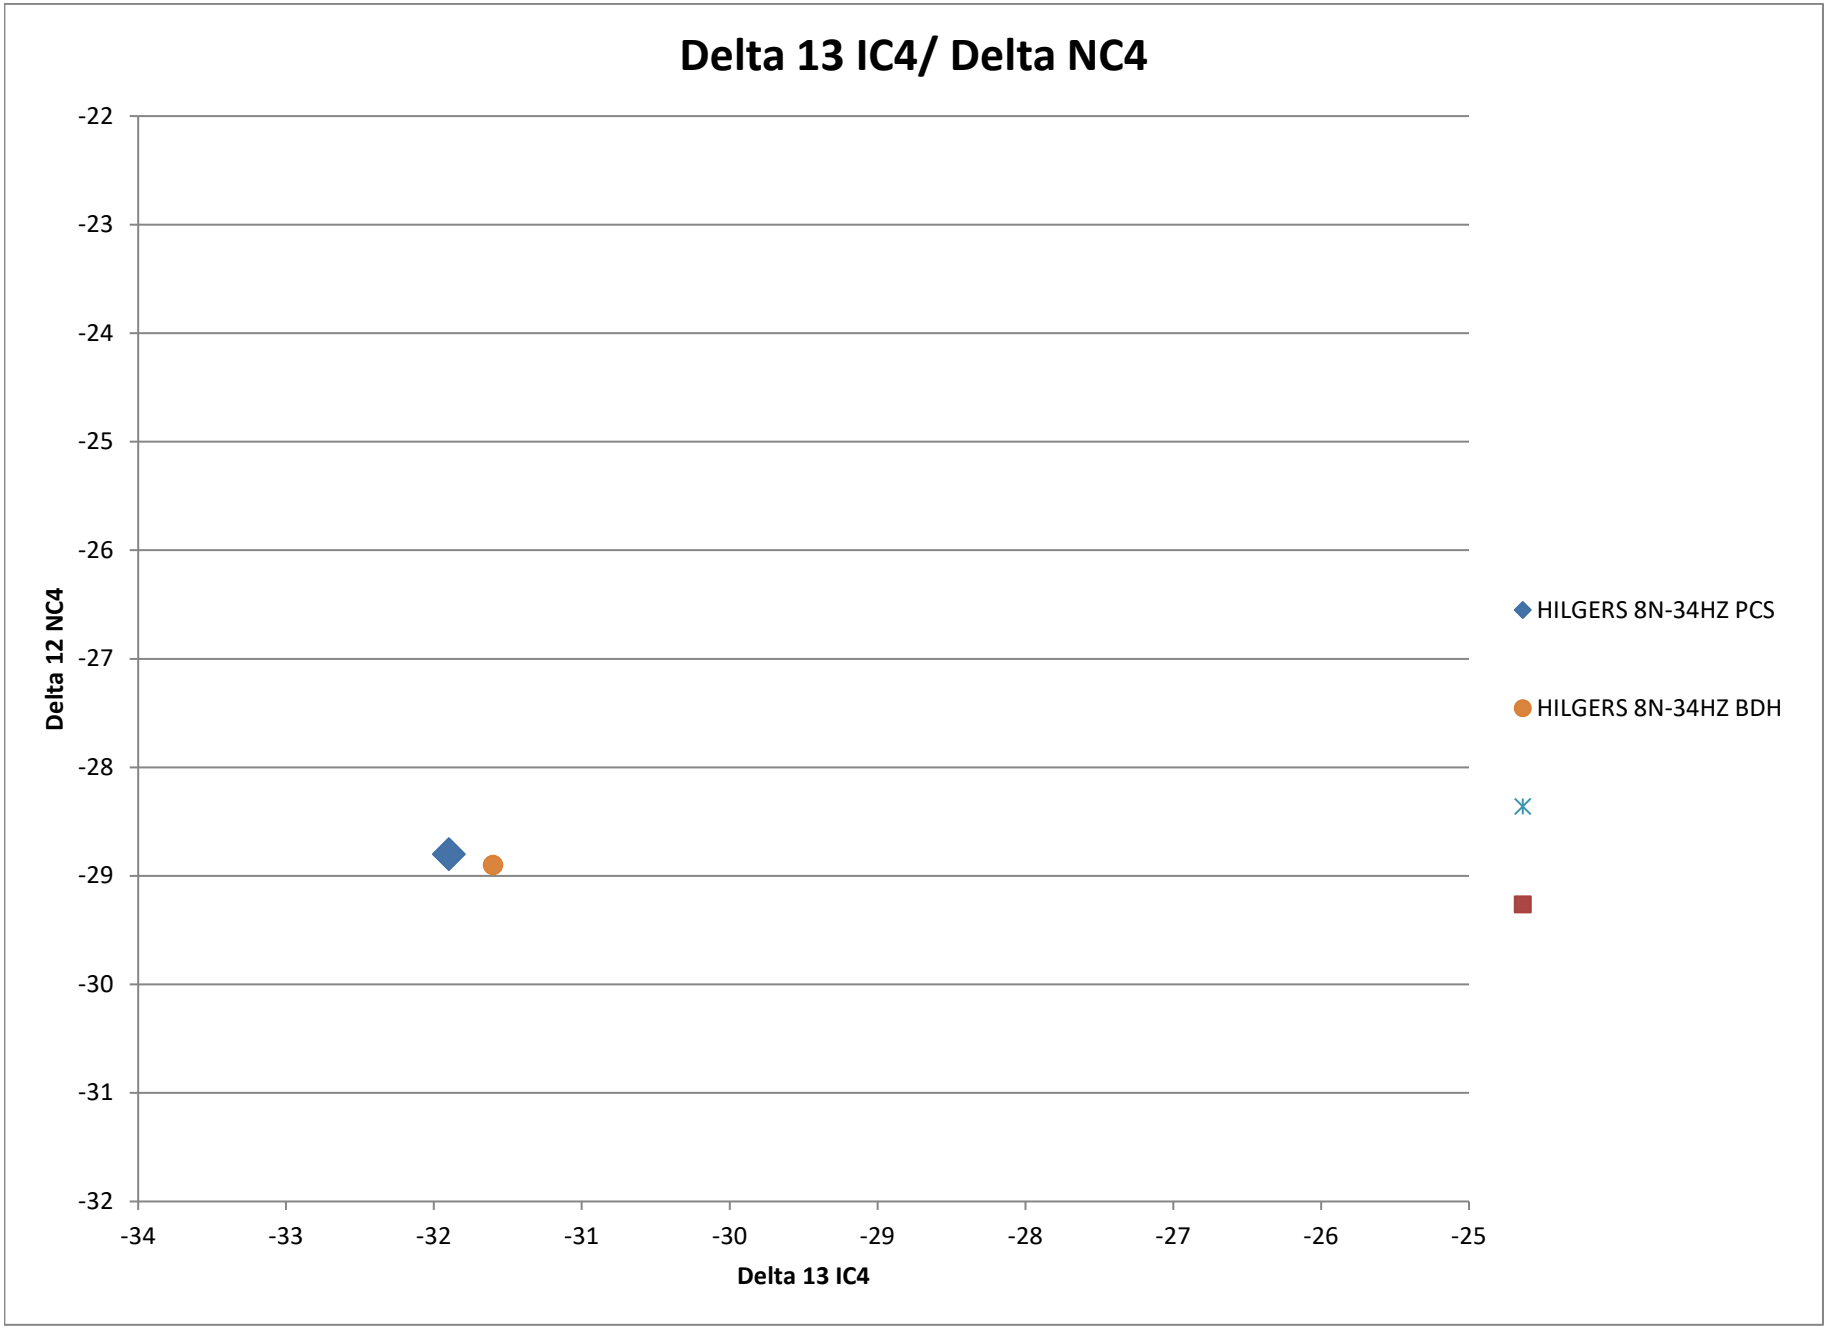
Delta 13 IC4/ Delta NC4
-22
-23
-24
-25
-26
-27
-28
-29
-30
-31
-32
Delta 12 NC4
-34
-33
-32
-31
-30
-29
-28
-27
-26
-25
Delta 13 IC4
HILGERS 8N-34HZ PCS
HILGERS 8N-34HZ BDH